



# Are They, Really?

**Special Thanks**  
**Rob Vilee, Executive Director**  
**Plainfield Area Regional**  
**Sewerage Authority**



Plants

Soil

Water

# Should They Be? Flushed?





# Are You a Folder or a Scruncher?

## The Wacky World of Negotiating Flushability



# Overview

- What is the definition of a Flushable?
- What problems are we seeing?
- What do they cost?
- Best Management Practices?
- How can they be managed?
- What is your role?

Plants

Soil

Water



[en.wikipedia.org/wiki/Fatberg](https://en.wikipedia.org/wiki/Fatberg)

A **fatberg** is a congealed lump of fat, sanitary items, wet wipes, and similar items found in sewer systems, which do not break down like toilet paper.



# 11 Ton Fat Berg in Queensland



22k

4K in NY

Plants

Soil

Water



# Definition

Only  
The three p's  
Pee, Poop and Toilet Paper

Plants

Soil  
Water



# National Association of Clean Water Agencies

Plants

Soil  
Water





# Okay to Flush?

Plants



Soil



Water



- Here are the reasons toilet paper is okay to flush:
- It rapidly loses strength when it gets wet.
  - It often breaks into pieces during the flushing action of a toilet.
  - It continues to break into pieces or fibers in the conditions normally anticipated in a typical wastewater collection system.
  - It does not require the force of a mechanical device to break it into pieces.
  - It has short fiber lengths that are unlikely to re-rope or entangle with other materials.
  - It does not cause problems in sewers, septic systems, or treatment facilities.
  - It is biodegradable and will not reduce the quality of biosolids.




# What should happen in the system

15 Minutes

Held in the

Slosh Box

City of Spokane  
Video

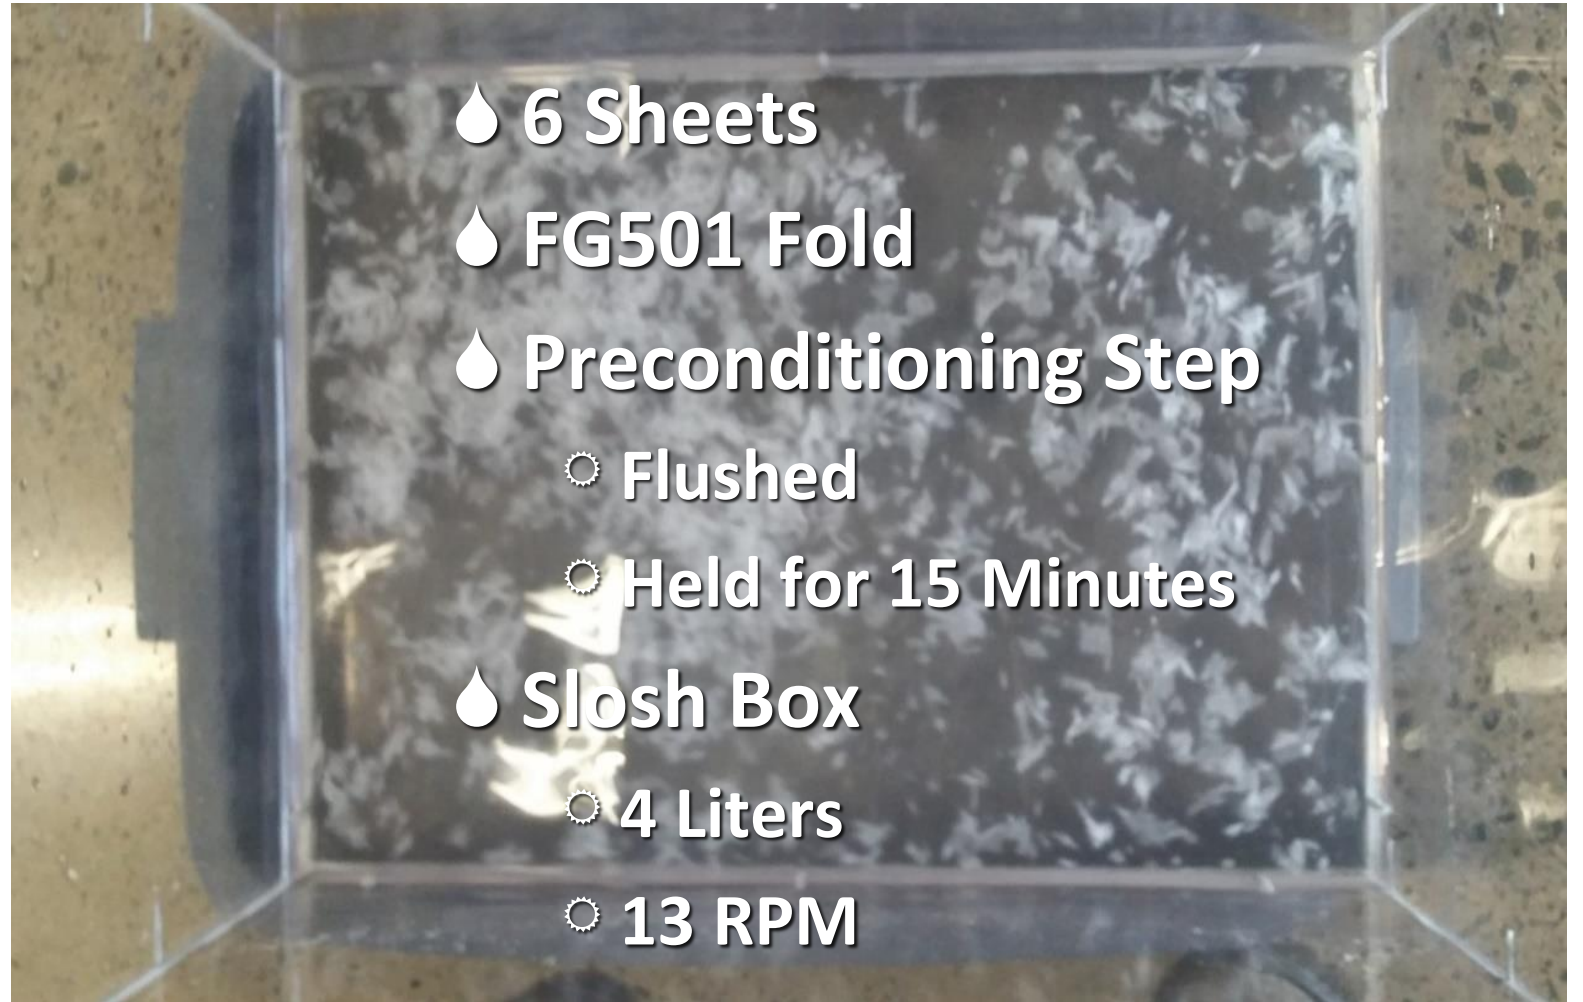

- 💧 6 Sheets
- 💧 FG501 Fold
- 💧 Preconditioning Step
  - ⚙️ Flushed
  - ⚙️ Held for 15 Minutes
- 💧 Slosh Box
  - ⚙️ 4 Liters
  - ⚙️ 13 RPM

Rotations Per Minute

BioLynceus Environmental Solutions®

© All Rights Reserved



Plants

Soil

Water

[Will It Flush? Video -](#)

[YouTube](#)

# To Prevent the Dreaded Poke Through

Re-enforced with nylon fibers  
And other non-degradable  
materials

Plants

Soil

Water




# How Flushable is that TP

- Toilet Tissue:** Toilet tissue is added to toilet events and bowel movements. Toilet tissue unit dose of toilet tissue is prepared by folding sheets (typically 6) into a square as shown. The number of sheets in a unit dose depends upon the test product will be marketed. The target is close to 3g of total material as per standard deviation calculation.

Use up to 4x less

Use less with every go

2-ply TP that is 4x Stronger

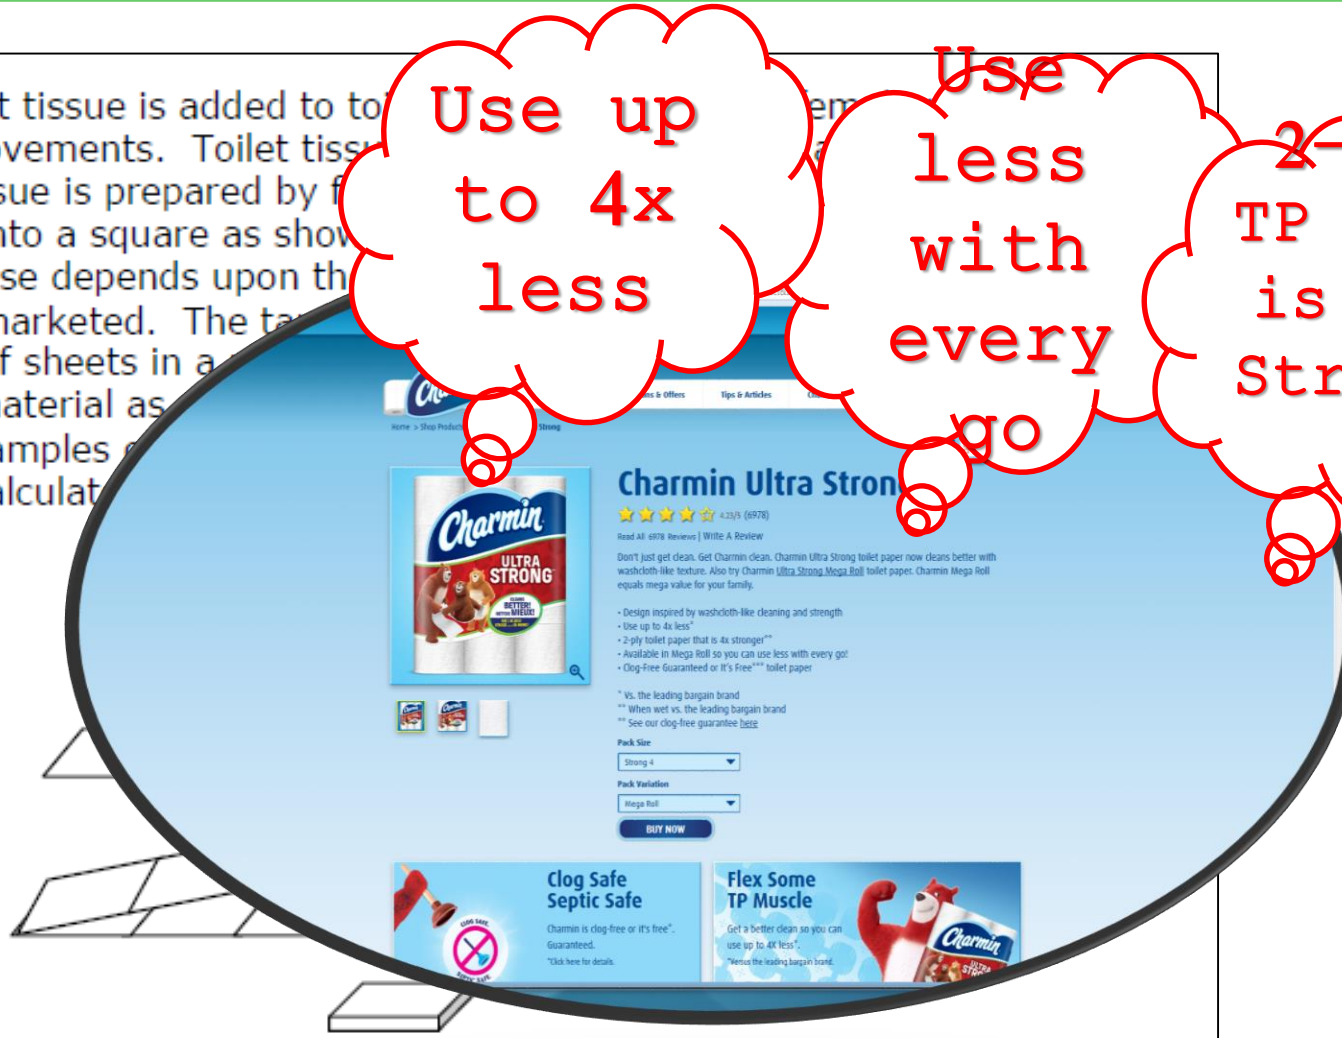

Folding of toilet tissue into an "unit dose"

Plants

Soil




Water



# How Flushable is that TP

Bath Tissue 1				Bath Tissue 2			
Time to First Break	No flush only	Flush wait 15mins	Flush wait 30 mins	Time to First Break	No flush only	Flush wait 15mins	Flush wait 30 mins
	Flowing pipe. 10", 50% full, 1ft/sec. R~18800	5	3		2	Flowing pipe. 10", 50% full, 1ft/sec. R~18800	5
Slosh Box 13rpm, 4l	15	3	6	Slosh Box 13rpm, 4l	21	21	15
Slosh Box 20rpm, 4l	5	2	1	Slosh Box 20rpm, 4l	5	4	1
Slosh Box 26rpm, 9l	4	1	1	Slosh Box 26rpm, 9l	3	2	3
Time to 1" pieces				Time to 1" pieces			
Time to 1" pieces	No flush only	Flush wait 15mins	Flush wait 30 mins	Time to 1" pieces	No flush only	Flush wait 15mins	Flush wait 30 mins
	Flowing pipe. 10", 50% full, 1ft/sec. R~18800	55	55		42	Flowing pipe. 10", 50% full, 1ft/sec. R~18800	64
Slosh Box 13rpm, 4l	89	72	79	Slosh Box 13rpm, 4l	141	147	130
Slosh Box 20rpm, 4l	31	23	21	Slosh Box 20rpm, 4l	41	38	38
Slosh Box 26rpm, 9l	58	42	41	Slosh Box 26rpm, 9l	63	60	49

- Proposed ED4 WW slosh set up highlighted in RED
- 9l , 26rpm Slosh providing closest comparison based on

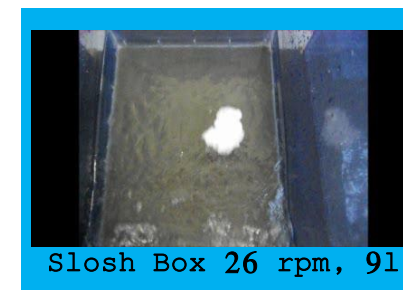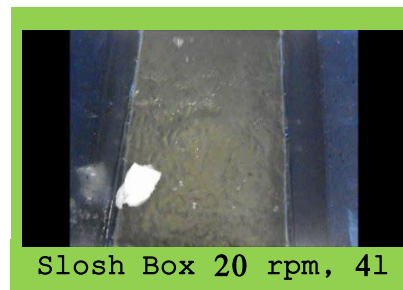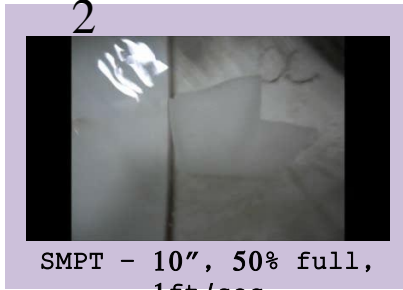

Statistics are used much like a drunk uses a lamppost: for support, not illumination. Vin Scully



# Characteristics for wipes – products labeled as “flushable”

Potential characteristics for wipes and any other product labeled “flushable” include the following:

- Like toilet paper, the product loses strength rapidly when flushed.
- The product breaks into pieces in a short period of time under conditions anticipated in a normal wastewater collection or septic system and without the aid of a mechanical device, such as a pump or grinder.
  - The pieces that the product breaks into should be one inch or less in any dimension, since pieces this size typically do not cause problems for pumps and other equipment.
  - The optimum time period for breaking down is still being determined, but it is clear that it needs to be less than 60 minutes since a wipe could reach a pump in that period of time. Some toilets may only be 10 minutes or less from the pump or septic system. Additional work is needed to determine if a shorter time period is required for typical collection systems.
- The product is made of 100% biodegradable fibers, to prevent microscopic or larger pieces from appearing in effluent or biosolids.
- The product is not buoyant.



# Cost of this Modern Miracle?

## Cost of cleaning Flushables

Denver

Reports spending \$100,000 per year to Haul off Wipes  
from collection system

New York

Has spent \$18 million in past 5 Years on wipe-related  
equipment problems

## Wickenburg

Plants

Soil

Water



# Contributors

Hospitals, Nursing Homes,  
Medical facilities, Day Care  
Manufacturing  
Industry  
Residential

Plants

Soil  
Water





# How Can You Control This Problem?

Plants



Education

Who do you educate?

Students

Employees

How do you enlighten them?

Tours

Haul a Load to their front door.

Soil



Water



# Local Example.... Education At Mancos, Colorado

Do Not Flush:

<http://mancoscolorado.com/admindocs/2015DontFlush.pdf>

Public Works | Town x  
mancoscolorado.com/government/public-works/



[Home](#) [Government](#) [Doing Business](#) [Visitors](#) [How do I...?](#) [Events](#) [Pay My Bill](#) [Hwy](#)

[Administration](#) [Boards & Committees](#) [Marshal's Office](#) [Parks & Recreation](#) [Development Services](#) [Public Works](#) [Mu](#)

[Home](#) > [Government](#) > Public Works

## Public Works

### [Snow and Ice Removal Plan](#)

### [Don't Flush That! Flyer](#)

The Town of Mancos Public Works Department is divided into two main areas. They are the streets/utility distribution (water & sewer) and the water/wastewater plants operation.

Robin Schmittel is our Public Works Director. He supervises the Plant Operator, Kyle Schreckenbach, as well as the Maintenance Supervisor.

[Water/Se](#)

[New Proper](#)  
[Transfer Ap](#)

[2011 Consu](#)

[2012 Consu](#)

[2013 Consu](#)

Plants

Soil

Water

Change from flushable  
to

**DO NOT FLUSH**

Plants

Soil

Water



# Educate Your Communities: Keep Fatberg's out of our sewers

Plants



Soil

Water



BioLynceus Environmental Solutions®

© All Rights Reserved



# New Products Being Added

Plants

Soil  
Water



BioLynceus Environmental Solutions®

© All Rights Reserved



# And for your little dog. too

Plants



Soil



Water



BioLynceus Environmental Solutions®

© All Rights Reserved



# Where Can You Buy Them?

Plants

Soil  
Water

Ebay  
Amazon  
ON Line Direct



# Other Countries:

Do Not Flush Toilet Paper Use the  
Trash Can  
or  
Use the Bidet

Plants

Soil

Water





Plants



Soil



Water




# Manufacturers Report As High As \$600 Million per Year In Revenue



# Baby Wipe Purchasing and Usage

Store brand baby wipes are the most often purchased by these respondents, followed by Pampers. One in five don't know what brand of baby wipes they purchase.

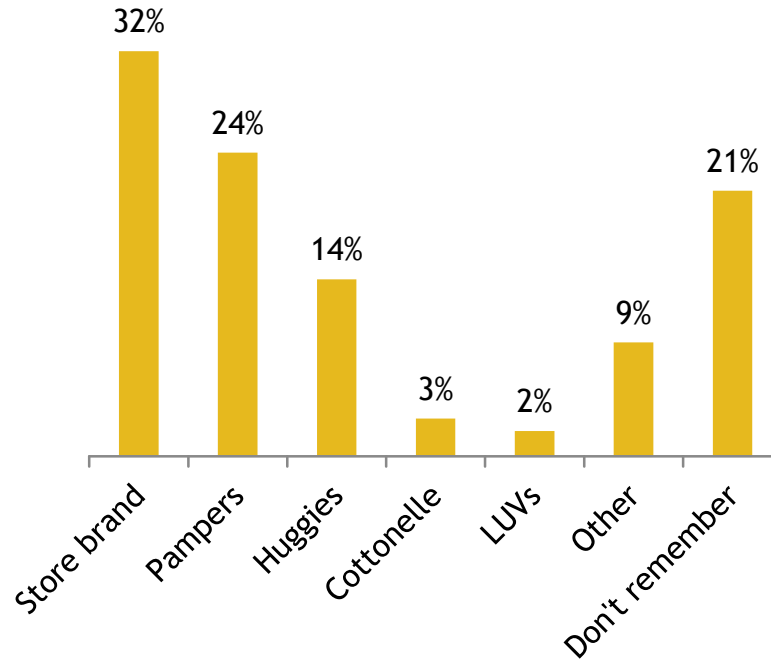

Baby wipes are most often purchased in the baby section of the store. Slightly less than half use baby wipes for baby care, as they are also used for personal hygiene, general cleaning and adult incontinence.

Q7. What brand of baby wipes do you purchase most often?  
 Q8. And in what area of the store do you purchase these baby 26  
 wipes? Q9. How are baby wipes used in your home? n=66

Where Purchased	
Baby section	73%
Toilet paper section	8%
Feminine hygiene section	3%
Other	9%
Don't know	9%

How Used	
Baby or toddler care	47%
Personal hygiene	39%
General cleaning	14%
Adult incontinence care	12%

**53% are off-label uses**

# Baby Wipe Disposal

Baby wipes users in this area are most frequently disposing of their baby wipes in the trash. While seven in ten never flush a baby wipe, almost a third flush them at least occasionally.

- 30 % flush them occasionally
- 10% most of the time



	Never	Occasionally	Frequently	Most of the time	Don't know
In the trash	6%	9%	18%	67%	-
In a diaper pail	83%	5%	5%	6%	2%
Flushed down the toilet	71%	17%	3%	9%	-

Note: While admittedly a very small sample, it appears that those who flush baby wipes span young and old age groups, both male and female respondents, HHs both with children and without, and across education and income levels.

Q10. How are used baby wipes disposed of in your home? For each of the following methods, please tell me if they are disposed of in this matter never, occasionally, frequently or most of the time. (n=66)

# We looked at Max Power Draw as well as Average Power Draw

Max Percentage over Base v. Average Power Draw Chart

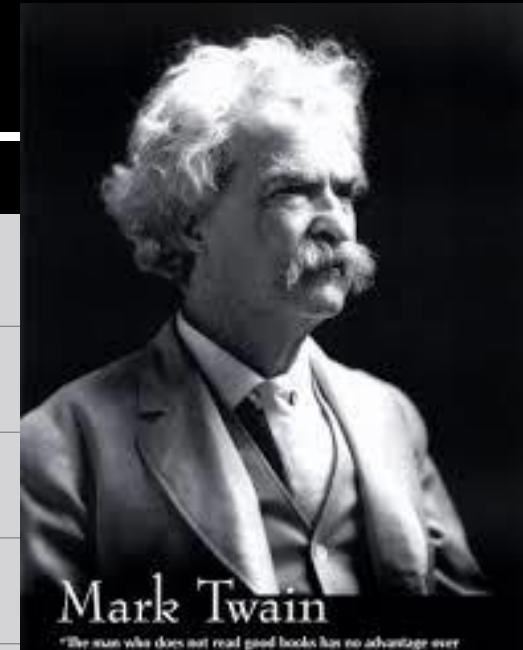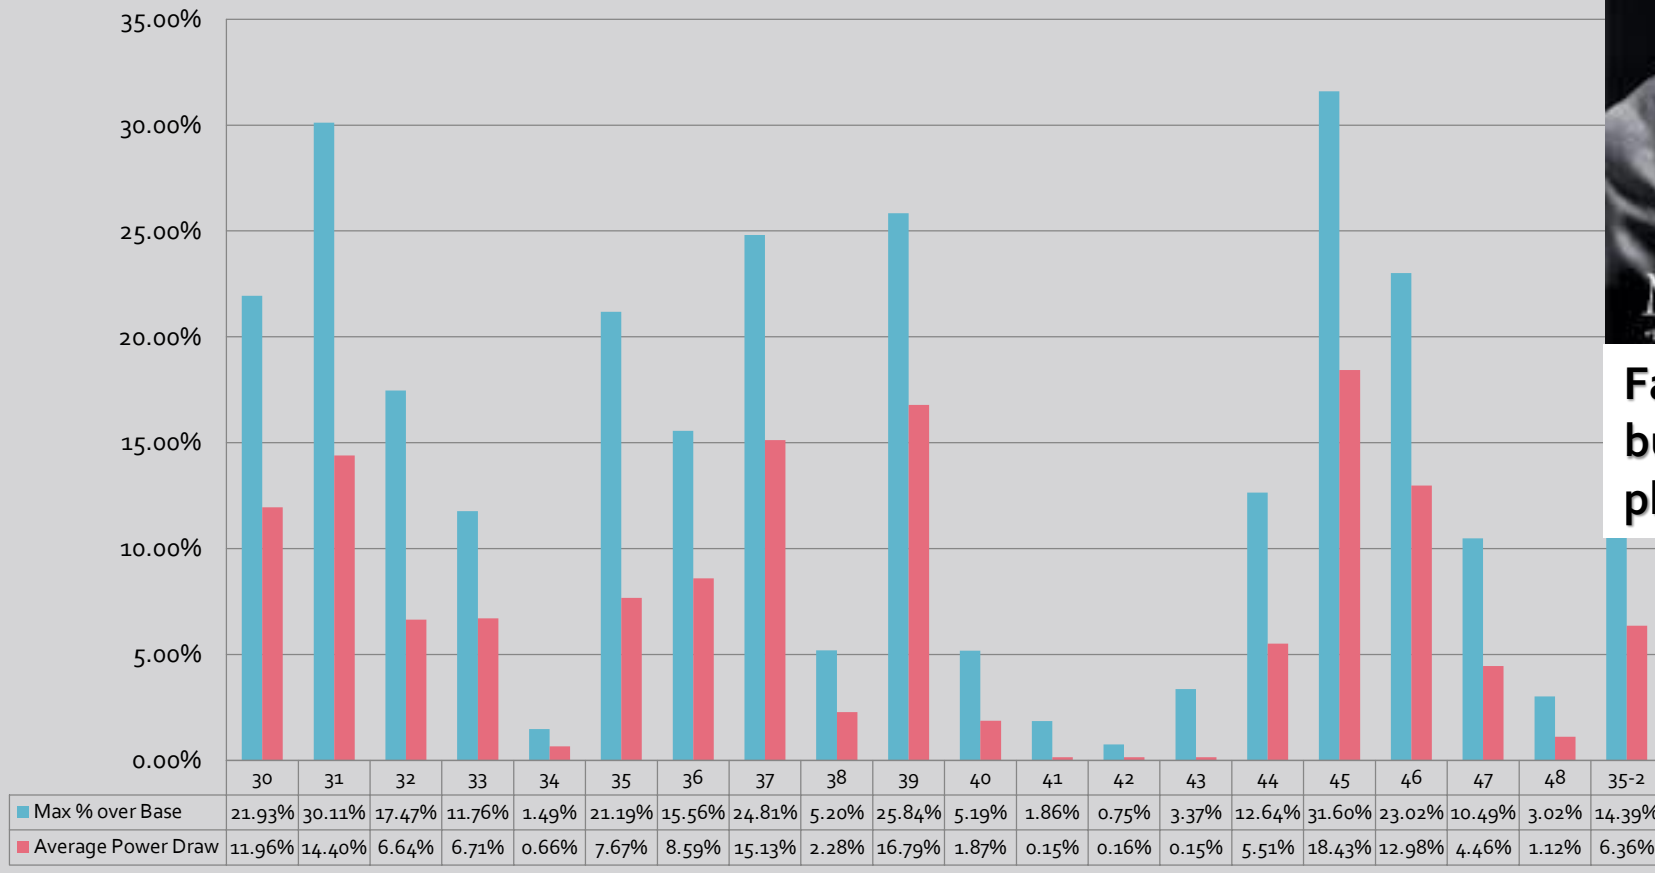

**Facts are stubborn,  
but statistics are more  
pliable**

# INDA Disintegration Test



# CFP – Continuously Flowing Pipe

- Designed to simulate a real sewer
  - 43 foot loop
  - Uses a conveyor to transport the wipes
  - Flow rate of 2.3 feet/second
- Used to calibrate other tests

# Continuously Flowing Pipe System



# Continuously Flowing Pipe





# Effect of Size on Power Consumption during Variable-Frequency Drive Operation

- **Purpose:** Evaluate the power draw of the Flygt C3085 Municipal Pump when dosed with the same mass of substrate (Non-flushable Baby Wipe) cut into different size shapes

<b>Dimensions</b>	<b>1.75 x 1.75"</b>	<b>3.5 X 1.75"</b>	<b>3.5 X 2.5"</b>	<b>7 X 5"</b>
<b>Pieces per wipe</b>	<b>16</b>	<b>8</b>	<b>6</b>	<b>Full Wipe</b>
<b>Average % Power Increase</b>	<b>5.6</b>	<b>7.3</b>	<b>8.7</b>	<b>12.2</b>

# Any Questions

