



Grease Control


(beyond BMPs)

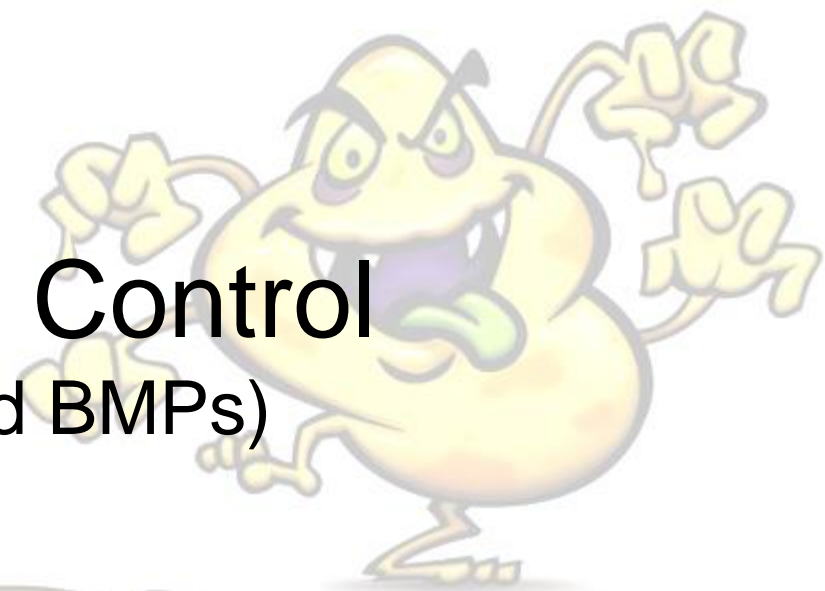

Dean Woehl
Industrial Pretreatment Technician
City of Bismarck

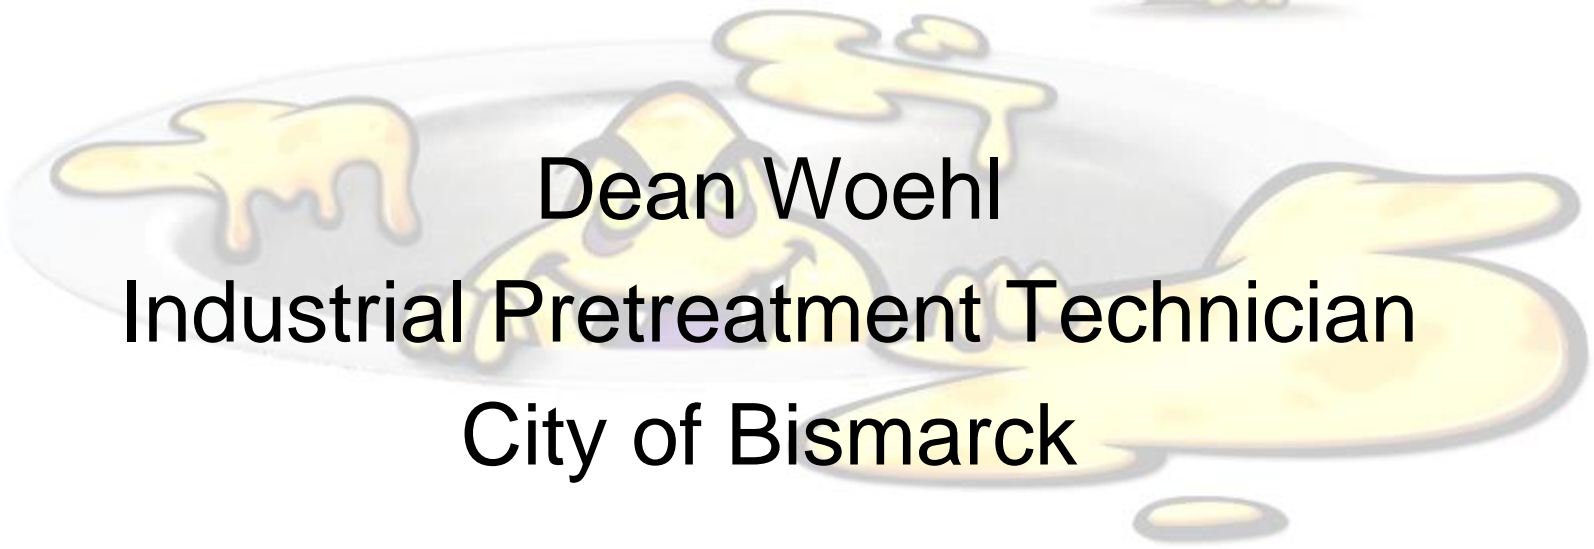

- 碗機都不應該接上水槽下式的攔阻系統，因為熱水
- 會溶解攔阻到的油脂，而使油脂直接通過攔阻器。
- 除非油脂攔阻器是特別設計用於處理固體廢棄物，
- 不然，垃圾切碎處理機的殘餘不應該進入油脂攔阻

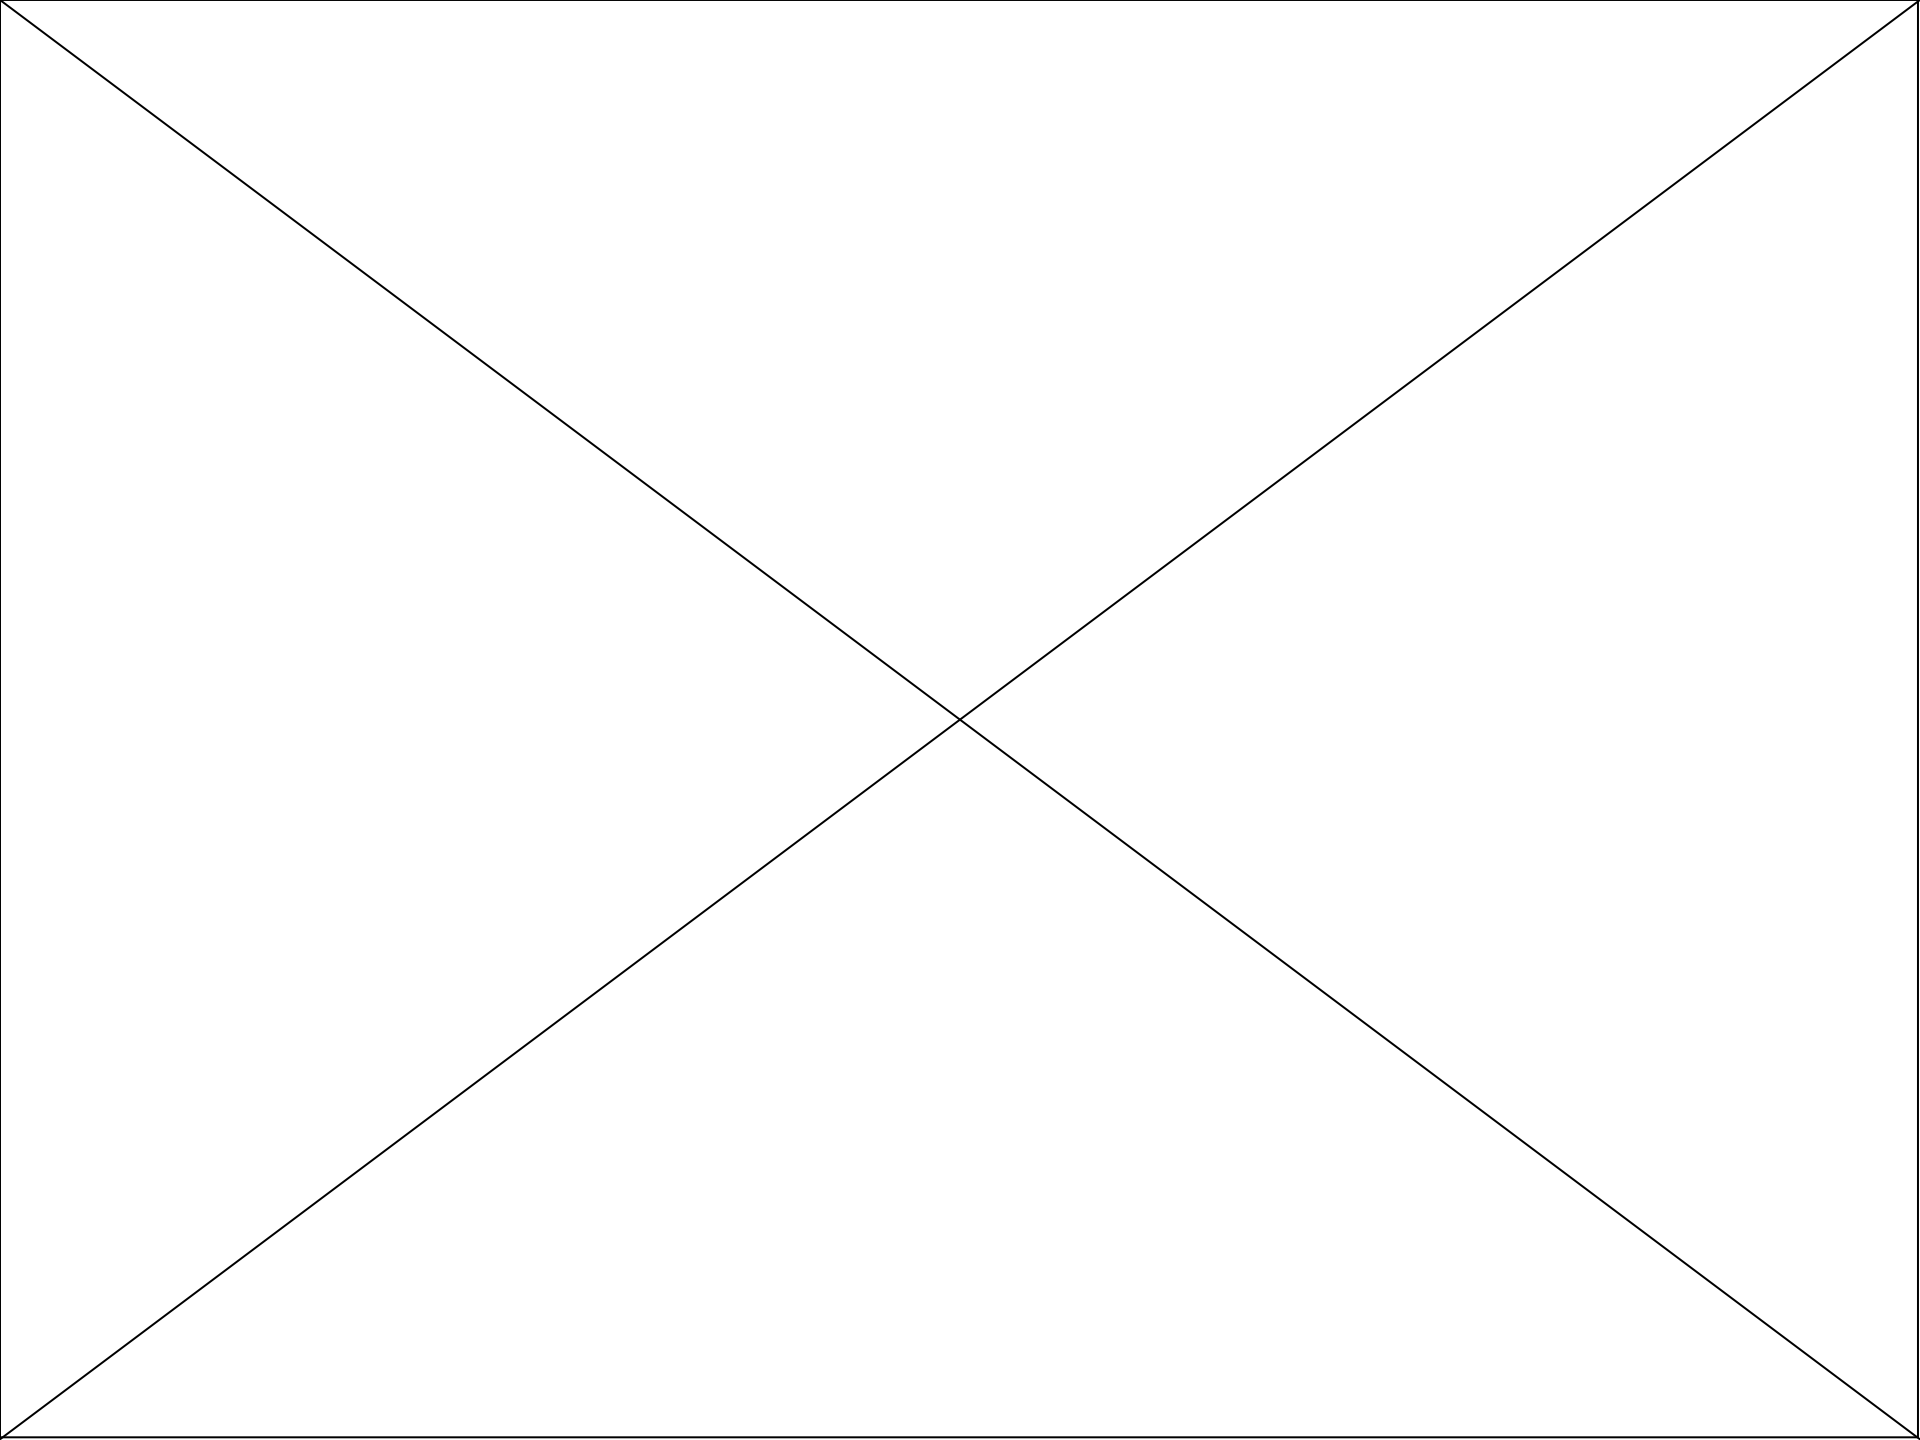

Impact Statement

- After policies have been implemented, compliance inspections must be performed.
- It is imperative to have an understanding of the devices you are inspecting and knowledge of the certification process for those devices.
- Determination of components missing or present, knowledge of what is supposed to be present is needed.

Agenda

- Review of Grease Removal Devices
 - Interceptor (GGI)
 - Trap (Hydro mechanical)
- Discussion on PDI Certification
- Tools of The Trade
- Example of Traps With Deficiencies
- Test
- Real World Example (we open a trap)

Two basic types of Grease Removal Devices

- **Gravity Grease Interceptors**

- grease interceptor must be large (usually installed outside underground) because it requires an extended time for grease separation (30 minutes or more). The separation is simply due to the specific gravity difference between FOG (fats, oils, and grease) and water.

- **Hydro Mechanical Grease Interceptors**

- (covered by PDI G101) is normally installed inside a building. They are compact in size because grease separation occurs quickly (about one minute) due to several simultaneous actions; a hydraulic flow action, air entrainment and the difference in specific gravity between water and FOG (fats, oils and grease).

Grease Interceptors

- Concrete Vaults
- Green Turtle
- Trapzilla
- Great Basin
- ECH2O™ Grease Removal System

Grease Traps

- Ashland Poly Trap
- Endura Canplas
- JR Smith
- Schier
- Wade Tyler
- Zurn



Canplas Endura



Schier *GB 25*




Schier Trapper II



Zurn

OCT

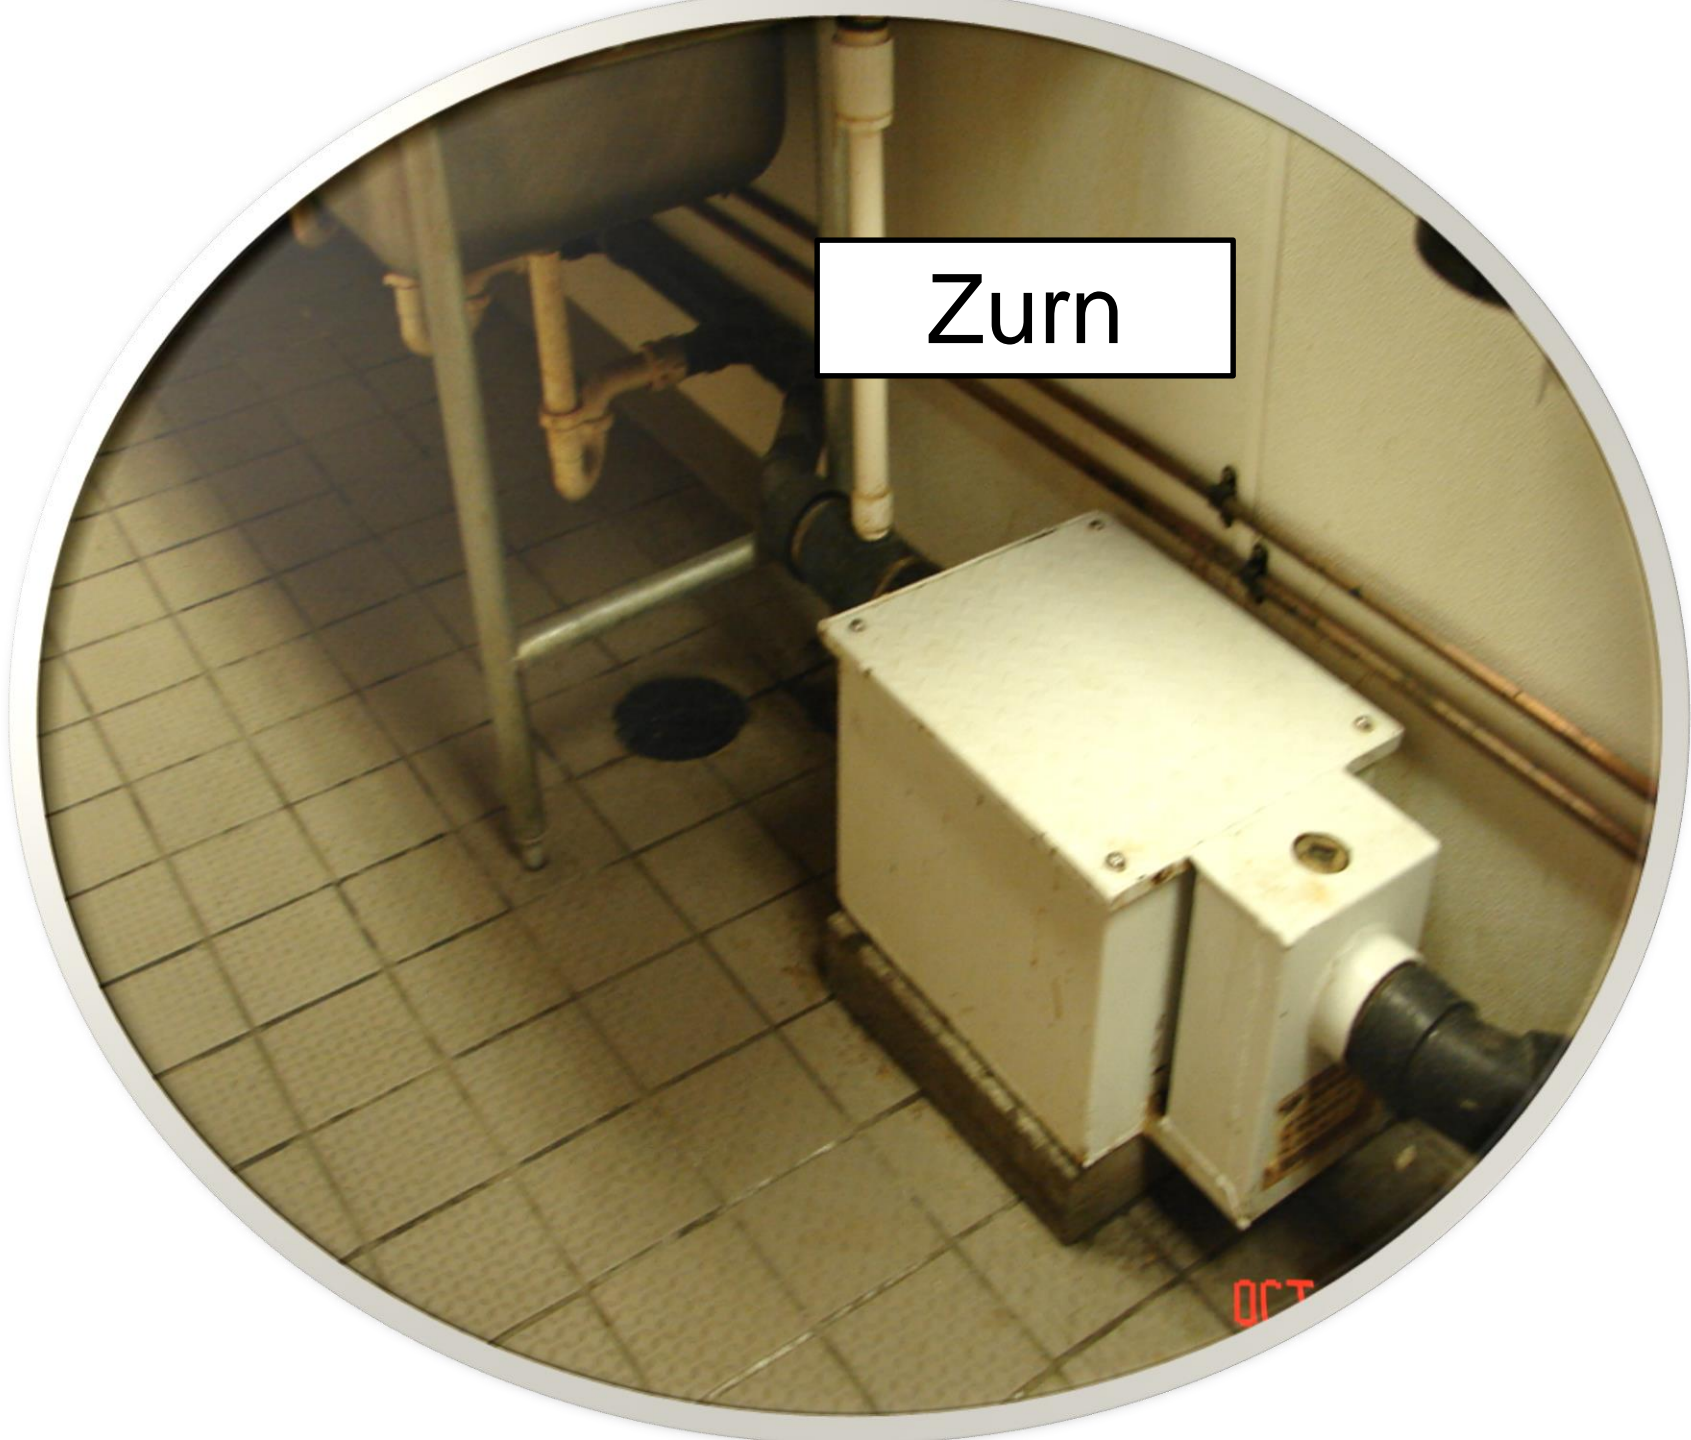

Zurn GT2700
Light Commercial



WADE





**SCHIER
PRODUCTS**
Pioneering Drain Line Purity

Trapner II Series
Grease Interceptor

Model Number: PATG-2635
Flow Rate: 35 gpm
Retained Grease: 120 lbs.
Liquid Capacity: 40 gal.
Serial Number: 2010-3080

Made in the USA
www.schierproducts.com 1-800-827-7119

0102 62 NNC

MANUFACTURER
CANPLIS INDUSTRIES

MODEL NO. 3070

FLOW RATE **LBS. GREASE**
G.P.M. CAPACITY

INLET SIZE


GREASE INTERCEPTOR COMPLIES WITH P.D.I. STD. G-101 WHEN INSTALLED WITH AN EXTERNAL VENTED INLET FLOW CONTROL. 22120/AS

B481.3 OPERATING INLET FCD

**PLUMBING AND DRAINAGE
PDI
CERTIFIED
INSTITUTE** ®

P.D.I. CERTIFICATION IS NOT A GUARANTEE OF PRODUCT NOR DOES IT ANTICIPATE CONDITIONS APART FROM THOSE IN PDI-G101

What it does and does not say

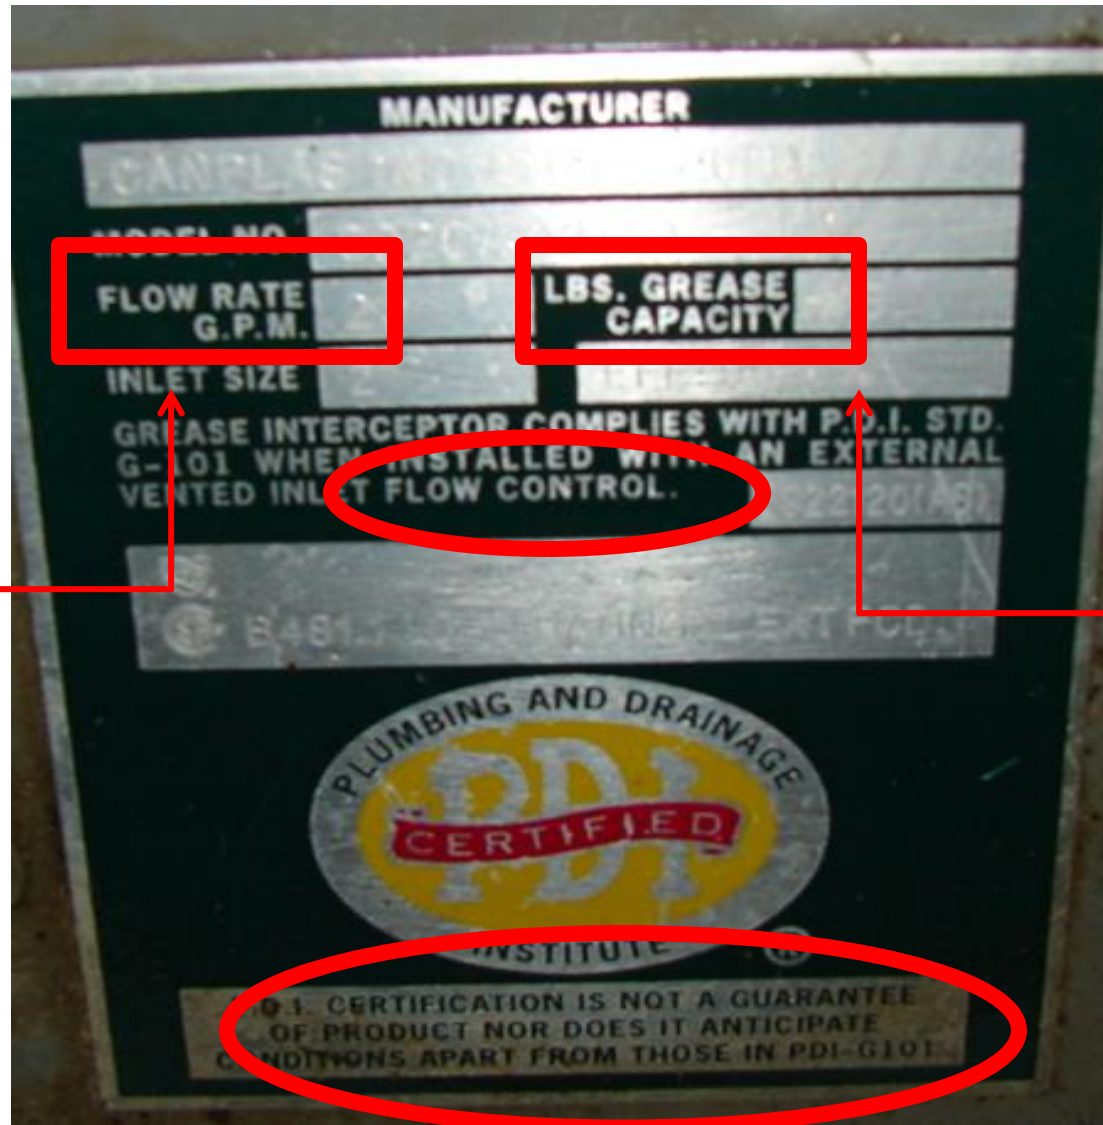

Makes no mention to the volume of water in trap

Maximum Limit

Minimum Limit

How Does a Manufacture Obtain a PDI Rating?

- PDI is contacted by the manufacture, stating the requested rating. PDI sets up a “controlled environment” for the requested rating.
- As long as the grease trap passes the parameters, it is certified.

Standard PDI-G 101 Revised January 2012

**Testing and Rating Procedure
for
Hydro Mechanical
Grease Interceptors
with
Appendix of Installation
and
Maintenance**

THE PLUMBING AND DRAINAGE INSTITUTE


Phone: (800) 589-8956

Web: www.pdionline.org

E-mail: pdii@pdionline.org



PDI Controlled Environment

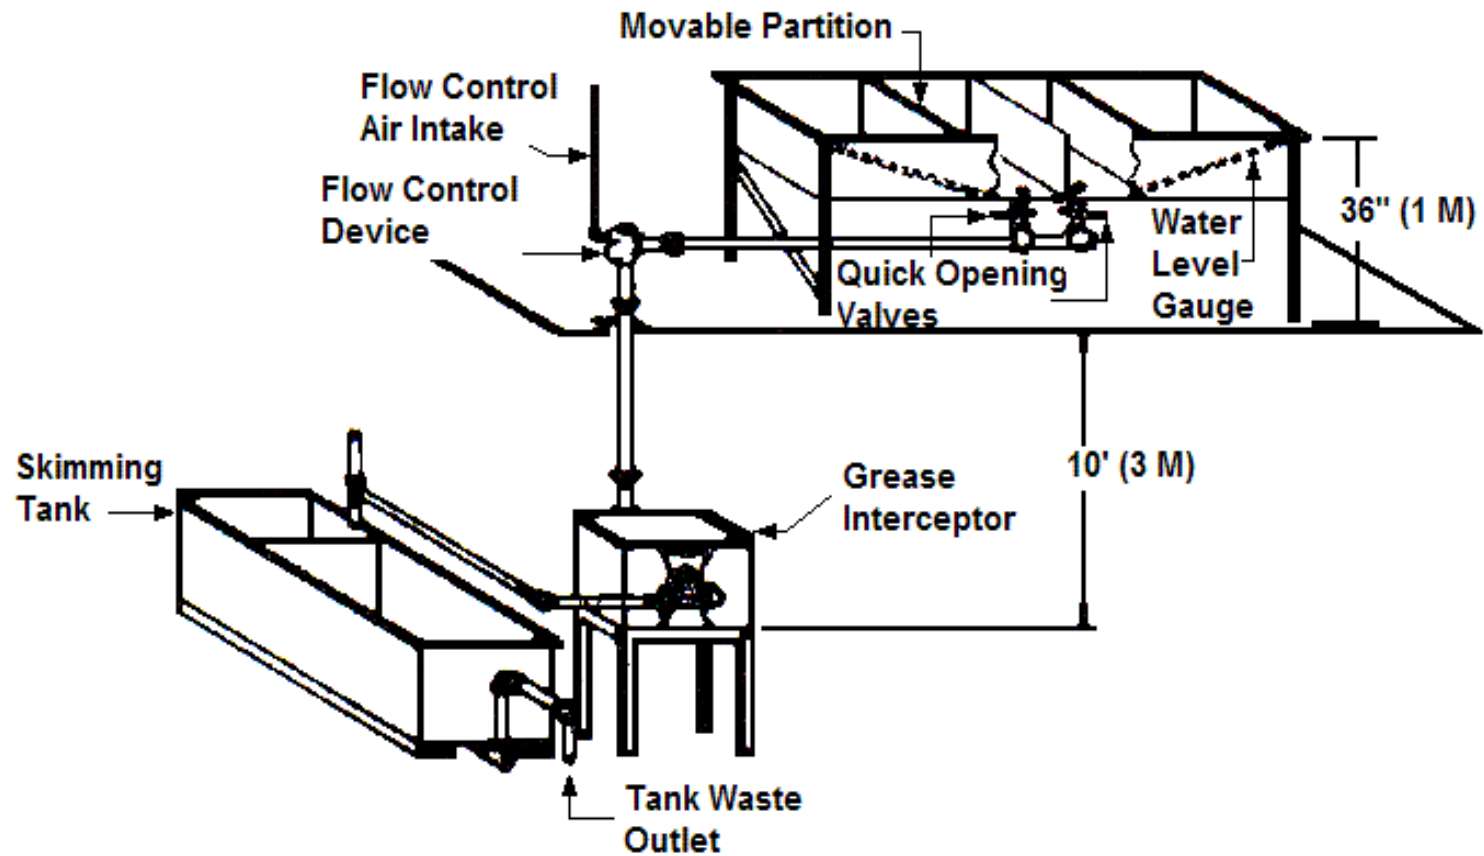

7.8 Requirements for Certification and Factor of Safety


To receive certification in accordance with the Plumbing and Drainage Institute Standard Testing Procedure for Grease Interceptors, the interceptor shall conform with or exceed the following requirements:

- a) Have an average efficiency of **ninety (90) percent** or more (See Section 7.7) at the rated grease retention capacity to flow rate, as indicated in Table 1
- b) Have an incremental efficiency of eighty (80) percent or more. (See Section 7.7)

the INSPECTOR must be familiar with the documents pertaining to each grease trap being inspected.

Without GRD manuals and an understanding of PDI, how do you know what is missing?

- Product Brochures
- Operation Manuals
- Installation Manuals
- Specification Sheets

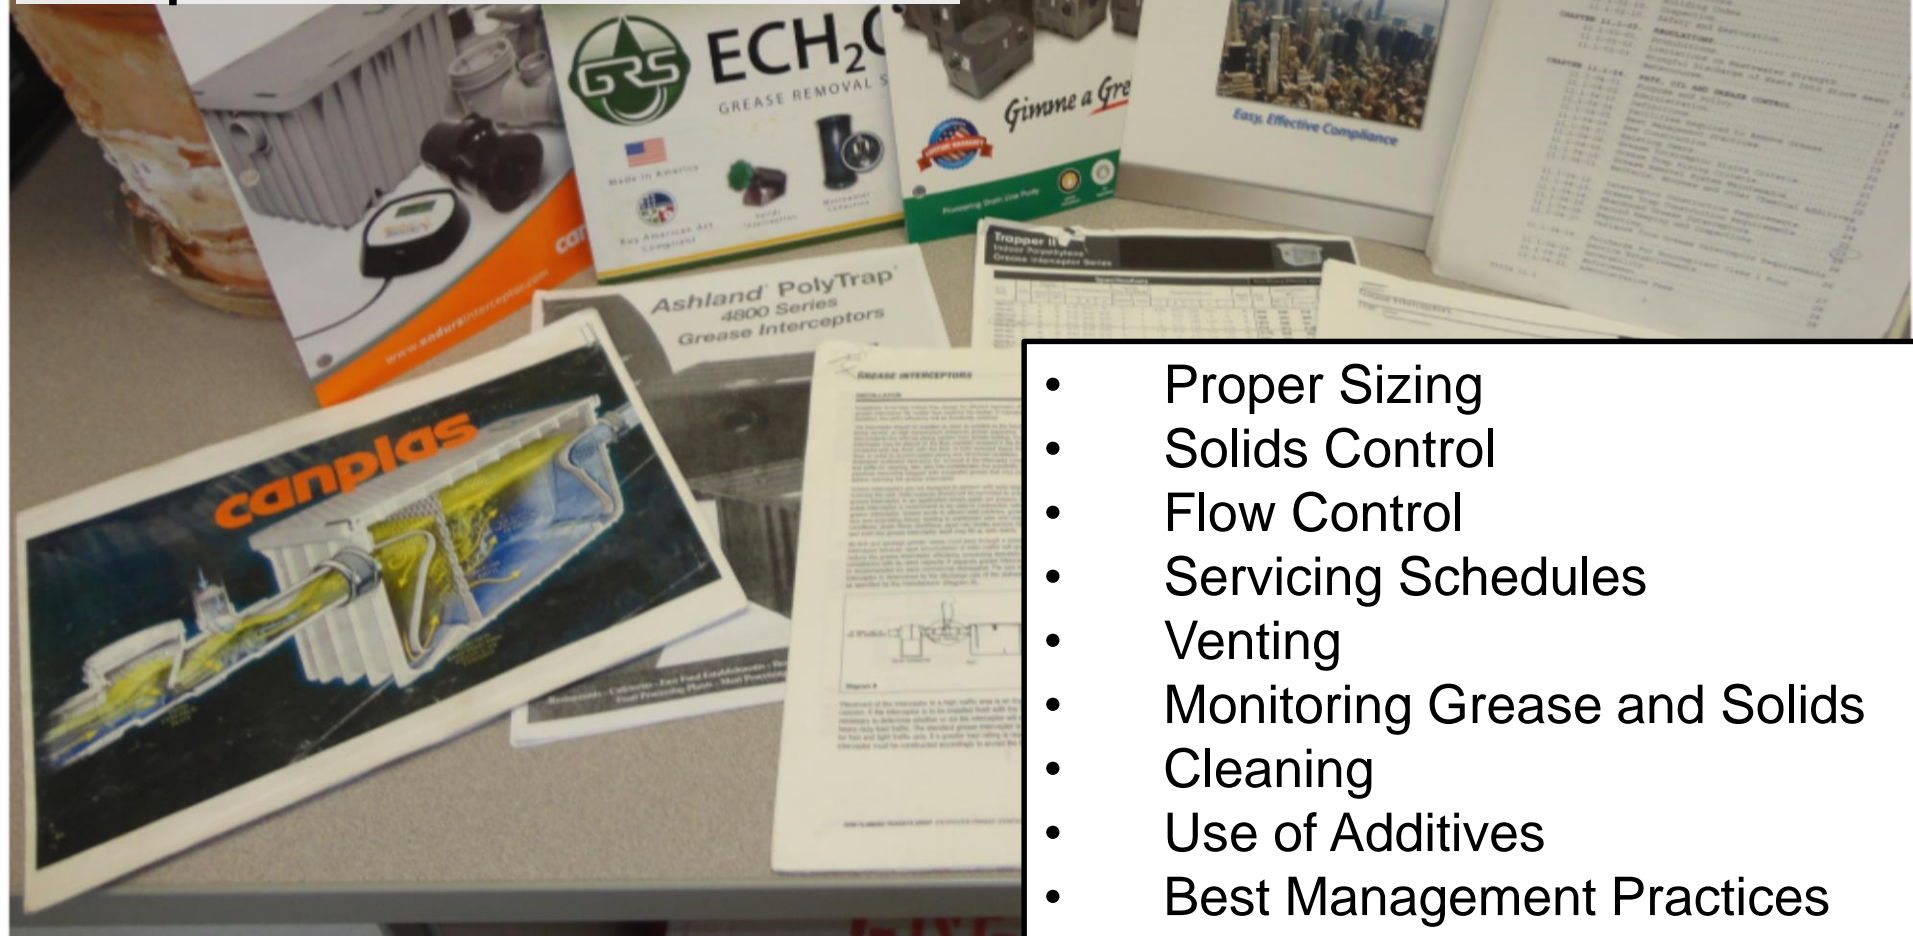

- Proper Sizing
- Solids Control
- Flow Control
- Servicing Schedules
- Venting
- Monitoring Grease and Solids
- Cleaning
- Use of Additives
- Best Management Practices

Canplas Installation Manual

Sizing Guideline

Sizing

For Grease Interceptor sizing, please reference the Sizing Guide or the Plumbing Drainage Institute Standard PDI-G 101. Without a properly sized flow control, the flow through the interceptor may exceed the rating of the unit, causing lower efficiencies and allowing grease to pass through the interceptor into the downstream piping. Be careful that you do not confuse liquid capacity and flow capacity. Liquid capacity is rated litres or gallons while flow capacity is rated in gpm (gallons per minute) or L/sec (litres per second).

If sizing indicates that a larger Grease Interceptor is required, you may be able to compromise to a smaller unit by adopting to a 2 minute drain down time in your sizing calculation. Although the smaller unit will be less expensive, the grease capacity of a smaller unit will dictate the cleaning frequency required.

Mop Sink Sizing Guide		
Size	LPS	US/GPM
2"	84	22
3"	142	37.5
4"	170	45

Floor Drains & Floor Sinks
Take the volume of water produced by the number of hose bibs (ie 1.5-2.0 gpm per 3/4" faucet)

Table A - Procedure for Sizing Grease Interceptors

STEP	FORMULA	EXAMPLE
1	Determine cubic content of fixture by multiplying length x width x depth	A sink 24" long by 20" wide by 12" deep. Cubic content: 24 x 20 x 12 = 5,760 cubic inches (61.0 x 50.8 x 30.48 cm ³)
2	Determine capacity in gallons. 1 gallon = 231 cubic inches	Contents in gallons: 5,760 / 231 = 24.9 gallons (94,451.42 / 1,000 = 94.45 litres)
3	Determine actual drainage load. The fixture is normally filled to approximately 75% of capacity with water as the items being washed displace about 25% of the total fixture content. Actual drainage load = 75% of fixture capacity	Actual drainage load: .75 x 24.9 = 18.7 gallons (0.75 x 94.45 = 70.84 litres)
4	Determine flow rate and drainage period. In general, good practice dictates a one minute drainage period; however, where conditions permit, a two minute drainage period is acceptable. Drainage period is defined as the actual time required to completely drain the fixture. Flow rate = $\frac{\text{Actual Drainage Load}}{\text{Drainage Period}}$	Calculate flow rate for one minute drainage period: 18.7 / 1 = 18.7 g.p.m. flow rate (70.84 / 1 min. = 70.84 l.p.m.) Calculate flow rate for two minute drainage period: 18.7 / 2 = 9.4 g.p.m. flow rate (70.84 / 2 min. = 35.42 l.p.m.)
5	Select Interceptor. From Table B select the interceptor with a flow rating at least equal to the calculated flow rate. When the calculated flow rate falls between two sizes, select the larger of the two interceptors.	For a one minute drainage period: 18.7 g.p.m. (70.84 l.p.m.) flow rate = 20 g.p.m. G.I. For a two minute drainage period: 9.4 g.p.m. (35.42 l.p.m.) flow rate = 10 g.p.m. G.I.

Table B - Procedure for Sizing Grease Interceptors

PDI Size Symbol	4	7	10	15	20	25	35	50
Flow Rate US Gallons per Minute (GPM)	4	7	10	15	20	25	35	50
Flow Rate Liters per Second (LPS)	.25	.44	.63	.95	1.26	1.58	2.20	3.16
Grease Capacity Pounds (Lbs)	8	14	20	30	40	50	70	100
Grease Capacity Kilograms (Kgs)	3.63	6.35	9.07	13.61	18.14	22.68	31.75	45.36

Sampling Access

Some municipalities require a sampling port to monitor effluent quality. If the unit is on the floor, or semi-recessed into the floor, a cleanout tee can be installed downstream of the Grease Interceptor. If the unit is installed in the floor, a backwater with its flapper removed, makes an effective collection port. Like the FCD the backwater valve can be extended to finish floor level using a sleeve kit.

Venting

Grease Interceptors must have a vented waste, sized in accordance with local code requirements for venting interceptors to retain a water seal and prevent siphoning. Most codes dictate that two vents be installed, one upstream and one downstream of the grease interceptor. The upstream vent must not be placed between the air intake and the grease interceptor.

ENDURA® GREASE INTERCEPTOR

OPERATION MANUAL

Train your employees so they can contribute to your goal of responsible waste management and reduced maintenance cost. Provide training in:

- proper function, operation and maintenance of grease interceptors
- proper storage, handling and disposal of wastes
- proper separation and storage of materials
- proper use and handling of cleaning aids
- proper housekeeping
- the benefits of following the code and the Best Management Practices for food sector facilities.

Monitoring Grease and Solids Collected

Using a piece of clear 3/4" (20 mm) diameter tubing, insert the tubing into the trap until it bottoms out. Place your thumb over the top opening, creating a vacuum that enables you to extract a cross section of the total liquid depth. Definite levels of solids, water and grease will be visible.

Cleaning & Maintenance

All grease interceptors must be cleaned regularly to maintain efficient operation.

The frequency of grease removal is dependent upon a variety of factors; the type of food served, the capacity of the grease interceptor and the quantity of grease in the water. Increasing the frequency of cleaning will reduce odour problems associated with grease traps and improve retention efficiency.

The maximum depth of solids permitted to accumulate at the bottom of the trap should not exceed 1" (25 mm).

The maximum depth of grease allowed to accumulate prior to servicing shall not represent more than 25% of the liquid volume of the grease interceptor or 2 1/2" (63 mm) deep on the 15/20/25 GPM (.94/1.26/1.60 Liters per Second - LPS) and 3" (76 mm) deep on 35/50 GPM (2.2/3.2 LPS).

!!!Caution!!!

Failure to maintain the Grease Interceptor can result in heavy fines from the local authority having jurisdiction and/or flooding as a result of the system backing up.

Grease weighs about 7 pounds(3.17 kg.) per gallon. If it is determined that a 20 GPM (1.26 LPS) 40 lbs (18 kg.) interceptor

accumulates about 5 gallons (19 liters) of grease every four days it would be easily and correctly assumed that the interceptor must be cleaned no less than once a week. Once an optimal grease removal interval has been established for a specific installation, regular cleaning at this interval is necessary to maintain the rated efficiency of the trap. After the accumulated grease and waste material has been removed, the interceptor should be thoroughly checked to determine that the inlet, outlet and air relief bypass port are clear of obstructions.


!!!Caution!!!

If there is an obstruction in the line, make sure the plugs are installed in the sinks or the ball valve is closed before accessing the waste piping.

The interior cavity of the grease interceptor and baffles can be cleaned using standard soaps and detergents.

Some municipalities require cleaning logs be maintained and kept for a minimum of 2 years. A sample of a form has been enclosed.

!!!WARNING!!! The use of certain cleaning agents such as chlorine, strong caustics, bleaches etc. in a concentrated solution can attack surfaces and void the unit's warranty.

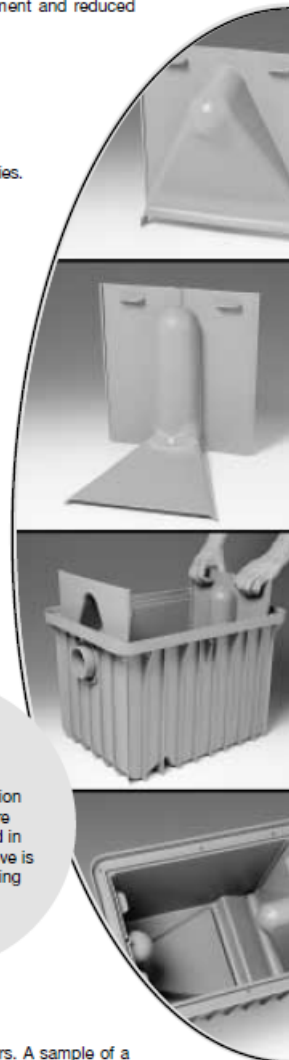

Schier Products Specification Sheet Showing Internal Flow Control

SPECIFICATIONS (PATG-1820)

- 2" inlet and outlet connections.
(No-Hub couplings included)
- Max flow rate: 20 GPM
- Liquid capacity: 17 Gallons
- Max grease capacity: 70 Pounds
- Unit weight w/std. covers: 37 Pounds
- Maximum operating temperature 190°F.

NOTES

- Unit is manufactured in accordance to ASME grease interceptor standard #A112.14.3
- Factory installed Built-In flow control.SM
- For gravity drainage applications only. Do not use for pressure applications.
- 3/8" thick high density polyethylene walls.
- Custom extension heights available.
- Three outlet options for easy rough in.
- Unit is shipped with outlet diffuser in location "B".
- Engineered inlet and outlet diffusers are removable to inspect/clean piping.
- For on-the-floor or buried applications.
- Locate interceptor as close as possible to grease producing fixtures.
- Kitchen-duty polyethylene cover with 5/16" stainless steel bolts.
(Load Capacity 500 lbs.)
- Integral Air Relief / Anti-siphon.

ENGINEERED INLET AND OUTLET DIFFUSERS

The inlet diffuser distributes incoming effluent into two paths that utilize the entire liquid volume of the tank for efficient grease separation. The calibrated openings greatly reduce effluent turbulence. The effluent enters the tank without disturbing the grease or sediment layers.


The outlet diffuser allows only effluent which is free of grease to exit the tank. It can easily be attached to any of the three outlets provided to ease jobsite piping layouts.

ENGINEER SPECIFICATION GUIDE



Grease Interceptor shall be Schier interceptor as manufactured by Schier Products, New Berlin, WI. Interceptor shall be lifetime guaranteed and Made in USA of seamless, rotationally-molded High Density Polyethylene with minimum 3/8" uniform wall thickness. Interceptor shall be furnished for above or below grade installation. Interceptor shall be built in accordance to ASME A112.14.3 (type C), with internal flow control, built-in test caps, and three outlet options. Interceptor grease capacity shall be at least three times its rated flow. Cover shall be gasketed and constructed of High Density Polyethylene with minimum 500 lb load capacity.

OPTIONS:


- EXT - Custom Extension to finished grade
- PS3 - 3" Inlet and Outlet connections
- MPT - Male pipe thread connections
- SC - 1/4" Steel treadplate cover

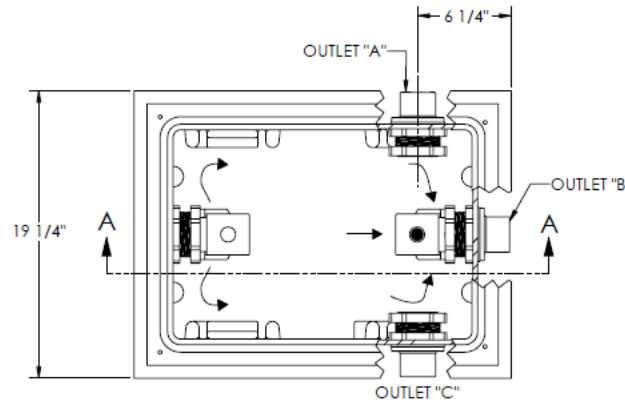

TOP VIEW
(W/O COVER)

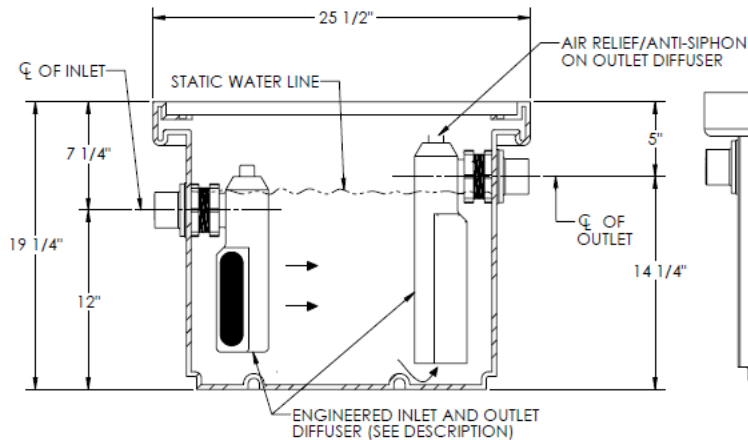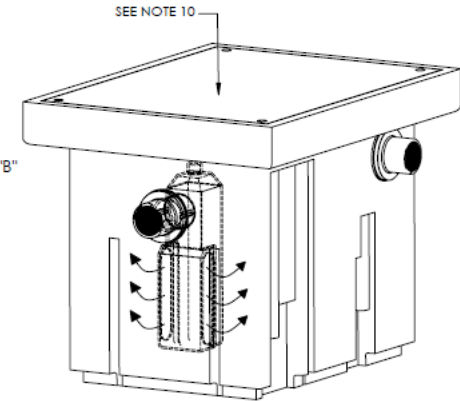

SECTION A-A

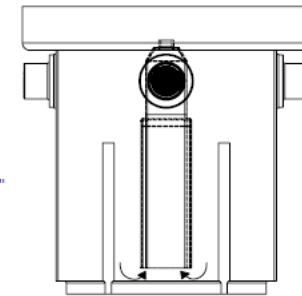

END VIEW

SPECIFICATION SHEET



GREASE INTERCEPTORS OIL SEPARATORS SOLIDS INTERCEPTORS CHEMICAL WASTE TANKS STAINLESS STEEL DRAINS

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SCHIER PRODUCTS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SCHIER PRODUCTS IS PROHIBITED.

DESCRIPTION:

20 GPM, 70 POUNDS GREASE STORAGE
17 GALLONS LIQUID HOLDING CAPACITY
POLYETHYLENE GREASE INTERCEPTOR

PART NUMBER: PATG-1820

MATL: HDPE

DWG BY: TEU

DATE: 11/21/06

REV: 3 - 8/14/08

Schier Products
2500 South 170th Street
New Berlin, Wisconsin 53115
Tel: 800-827-7119
Fax: 800-827-9664
www.schierproducts.com

Made in the U.S.A.






Z-1170
GREASE INTERCEPTOR

SPECIFICATION SHEET

TAG _____

Dimensional Data (Inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

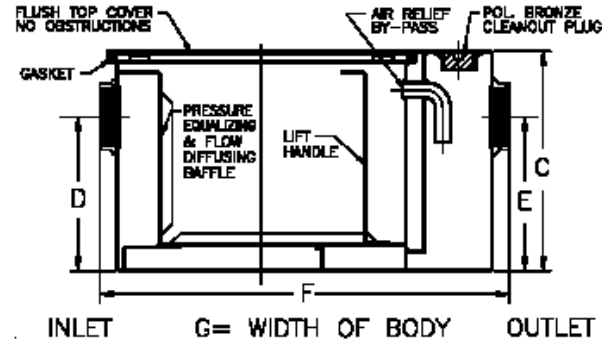

Zurn Speciation Sheet

Showing Inlet and Outlet

Size	Inlet/ Outlet Size**	Flow Rate G.P.M. [L]	Capacity		Approx. Wt. Lbs. [kg]	Dimensions in Inches			
			Water Gal. [L]	Grease Lbs. [kg]		C	D/E	F	G
100	2 [50]	4 [15]	3 [11]	8 [4]	42 [19]	10 [254]	7 1/4 [184]	19 [483]	9 7/8 [251]
200		7 [28]	5 [19]	14 [6]	53 [24]	11 1/4 [298]	8 1/8 [206]	20 3/8 [518]	11 7/8 [302]
300		10 [38]	8 [23]	20 [9]	66 [30]	11 3/4 [298]	8 1/4 [210]	22 5/8 [575]	14 [356]
400	3 [75]	15 [57]	10 [38]	30 [14]	83 [38]	13 3/8 [340]	9 3/8 [238]	24 5/8 [625]	16 3/4 [425]
500		20 [76]	16 [60]	40 [18]	99 [45]	15 [381]	11 3/4 [298]	27 1/2 [698]	17 1/4 [438]
600		25 [94]	21 [79]	50 [23]	124 [56]	17 [432]	12 1/2 [318]	29 7/8 [759]	19 7/8 [505]
700		35 [132]	30 [113]	70 [32]	151 [68]	18 3/4 [476]	14 1/4 [362]	31 3/4 [806]	22 1/2 [572]
800		50 [189]	40 [151]	100 [45]	180 [82]	21 1/2 [546]	16 [408]	33 5/8 [854]	24 1/2 [622]

ENGINEERING SPECIFICATION: ZURN Z-1170 Acid Resistant Coated Interior and exterior fabricated steel grease Interceptor, PDI, rated at GPM and _____ Lbs. grease capacity, with Internal air relief by-pass, bronze cleanout plug and visible double wall trap seal with removable combination pressure equalizing/flow diffusing baffle and sediment tray. Gasketed non-skid secured cover, complete with Z-1108 flow control fitting. Regularly furnished inlet and outlet in high position. Note: Location of outlet from bottom for interceptor cannot be changed.

PREFIXES

- ___ Z- Acid Resistant Coated Fabricated Steel*
- ___ ZS- All Type 304 Fabricated Stainless Steel


SUFFIXES

- ___ -D1 Dual High/Low Inlet.
- ___ -E Acid Resistant Coated Interior and exterior fabricated steel extension section. (Specify 'C' Dim. required) for recessed installation.
- ___ -EP Enzyme Port In Cover.
- ___ -HD Heavy Duty Cover
- ___ -K Anchor flange 1 3/4 [44] down from top and 2 [51] wide. A 3 [76] minimum extension height is required when anchor flange (-K) option is specified. (Specify 'C' Dim. height required.)
- ___ -KC Anchor flange 1 3/4 [44] down from top and 2 [51] wide with clamp collar. A 3 [76] minimum extension height is required when anchor flange (-K) option is specified.
- ___ -L Angle type (Z-1108-L) flow control device.
- ___ -R Recessing receiver for recessed installation is equipped with adjustable support brackets and gasketed non-skid cover with covered recessed lift handle.
- ___ -RE Recessing receiver enclosed type for recessed installation. Furnished with adjustable support brackets and gasketed non-skid secured cover with covered recessed lift handle.
- ___ -T Cover recessed for tile/terrazzo. A 3 [76] minimum extension height is required. (Specify 'C' Dim. and required recess depth - 1/8 [3], 3/4 [19], or 1 1/4 [32]).
- ___ ** Inlet and outlet sizes shown indicate standard operating sizes and flow control setting. Size #300 will have 3[75] connections reduced to 2[50] and sizes #600 thru #800 will have 4[100] connections reduced to 3[75] as standard. If changed, flow control must be adjusted accordingly.

REV. C	DATE: 10/11/96	C.N. NO. 76171
DWG. NO. 58905	PRODUCT NO. Z-1170	


*REGULARLY FURNISHED UNLESS OTHERWISE SPECIFIED

...and here's a chart that shows what you might see if you looked at a mountain range through a tennis racket.

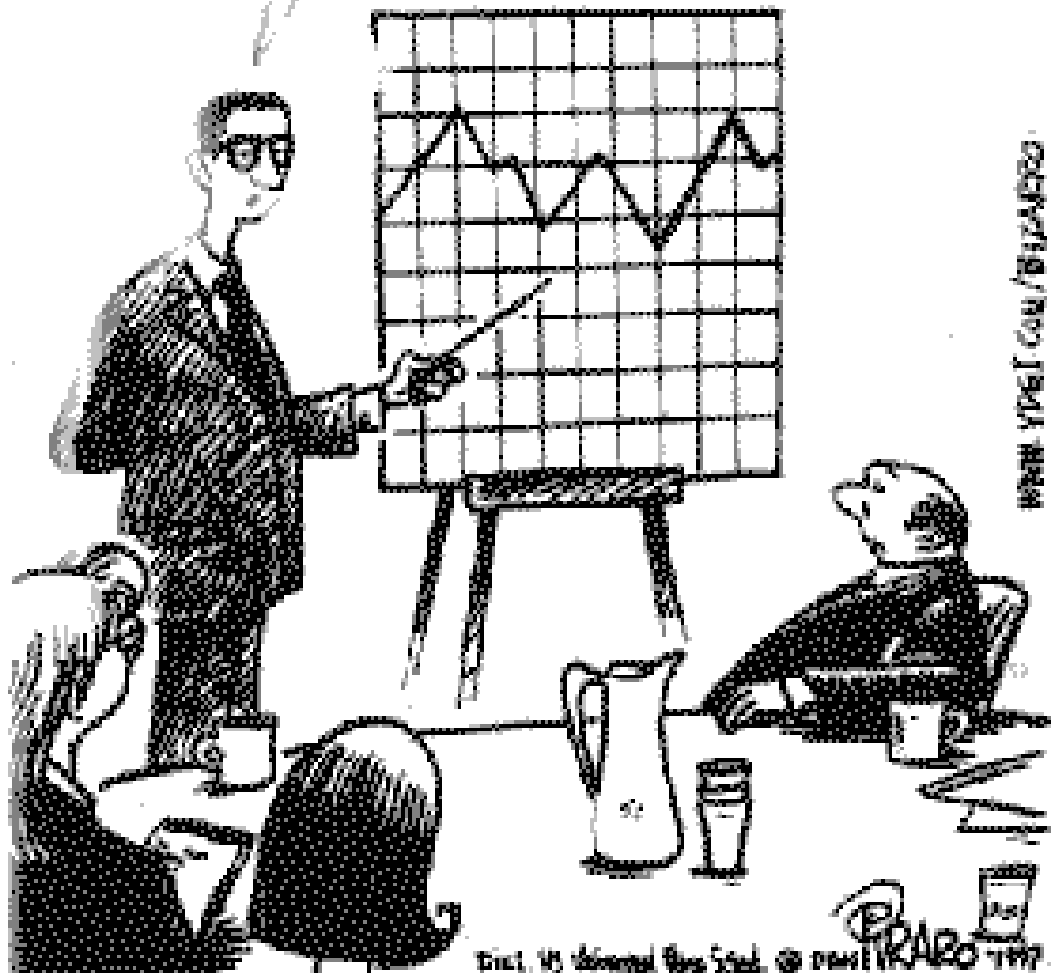

WWW.YTNET.COM/BIZARRO

World's Most Accurate Pie Chart

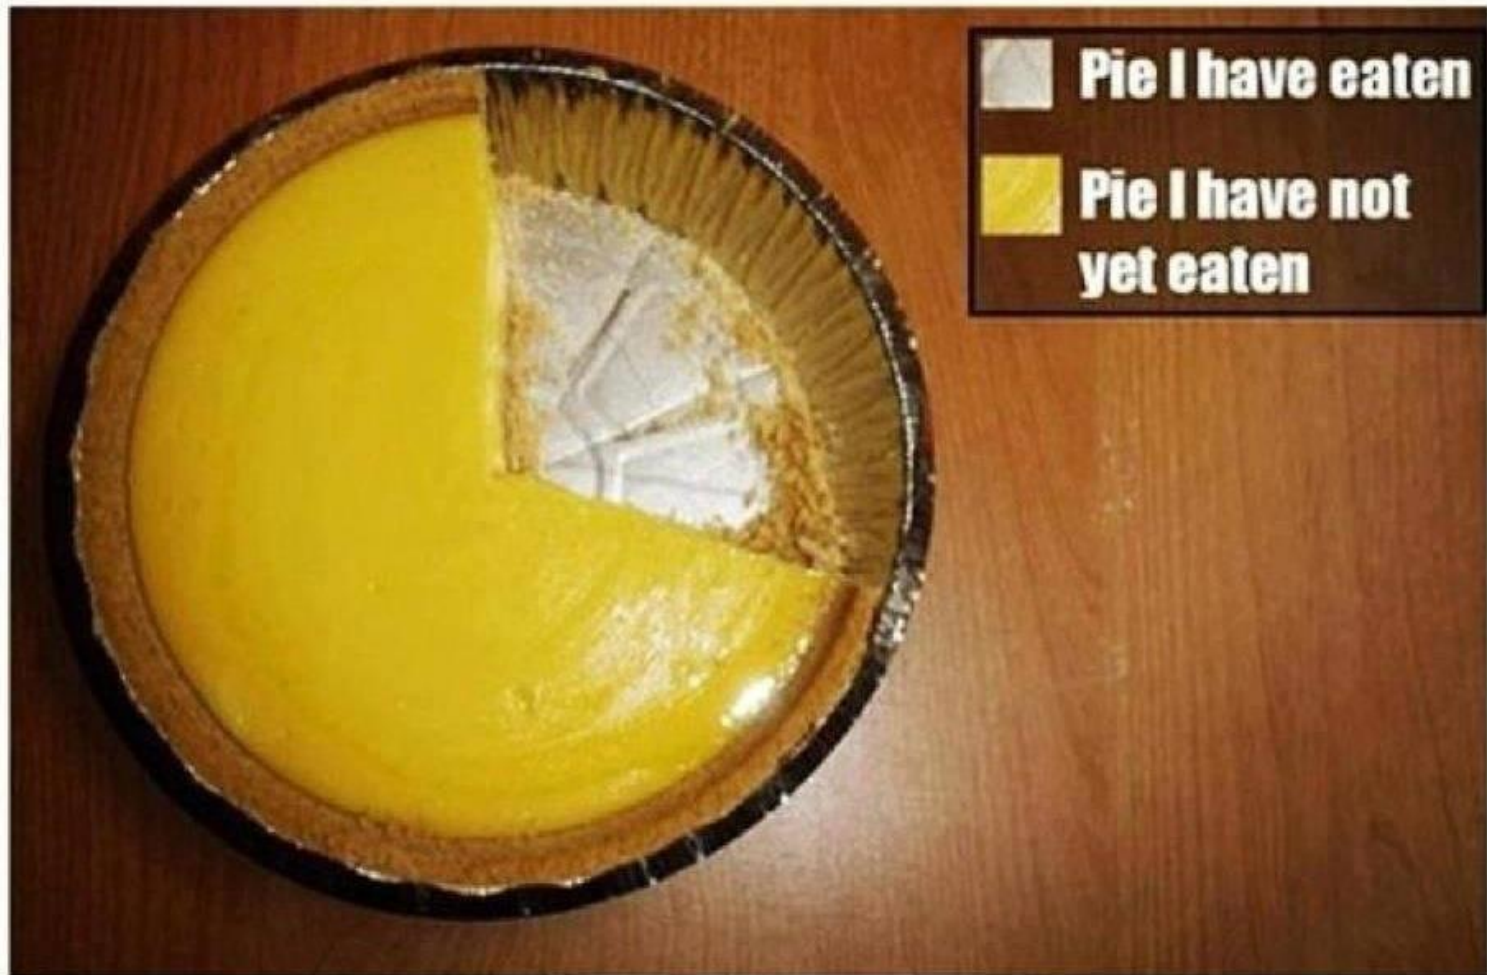

WELLS FARGO ATM

CAMEL 3659
MILK GALLON
SKIM \$334

SPEED
LIMIT
40



Grease Traps with deficiencies

Identify the problem (s)




CAUTION!
DO NOT TOUCH THE HOT SURFACE
OR YOU WILL BE BURNED

SEP 3 2009

Flow Control Device Installation

The flow control device furnished with the Endura Grease Interceptor is essential to the proper operation of this unit. The flow control limits the unit to its rated capacity allowing enough time for grease separation to take place inside the interceptor.

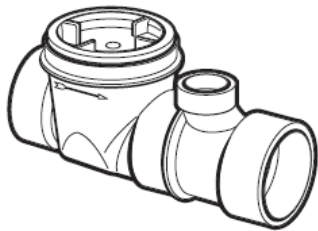


The flow control fitting is molded in PVC and must be solvent welded using PVC solvent cement, **upstream** of the interceptor. It is to be located in the drain line beyond the last connection from the fixture and as close as possible to the underside of the lowest fixture. When the discharge from two or more sinks or fixtures are combined and served by one interceptor, a single flow control fitting should be used.

The installation of a ball valve upstream of the flow control is recommended. A ball valve provides a means of drain line isolation and will prevent flooding if the maintenance person forgets to install the sink plugs to alleviate head pressure.

Some local plumbing codes require that grease interceptors have an internal flow control to ensure drain lines do not bypass the grease interceptor. However, if the flow control device is located immediately upstream of an interceptor, this is often considered as forming part of the interceptor. Therefore, officials having jurisdiction may accept such design as meeting the intent of the requirement. If local codes dictate the flow control must be installed directly preceding the grease interceptor inlet, and the fixtures being served are in excess of 8 ft (2.4 m) from the interceptor, we recommend a second flow control being installed as close to the last fixture as possible. Please contact your local representative if you require further clarification.

Note: Some local jurisdictions require that the interceptor service the floor drains. The floor drain must bypass the flow control to ensure the restriction does not flood the drain. Therefore, the flow control should be installed as close to the fixture as possible or directly preceding the floor drain connection.

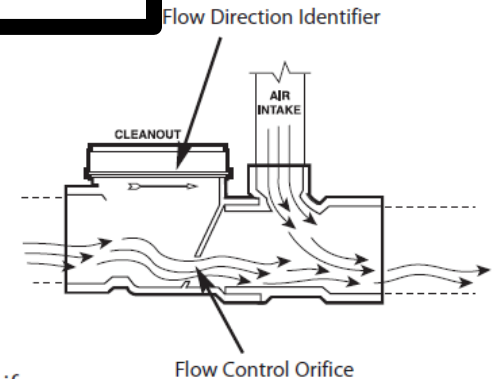




Service R
OPERATION MANUAL



SEP 3 2009

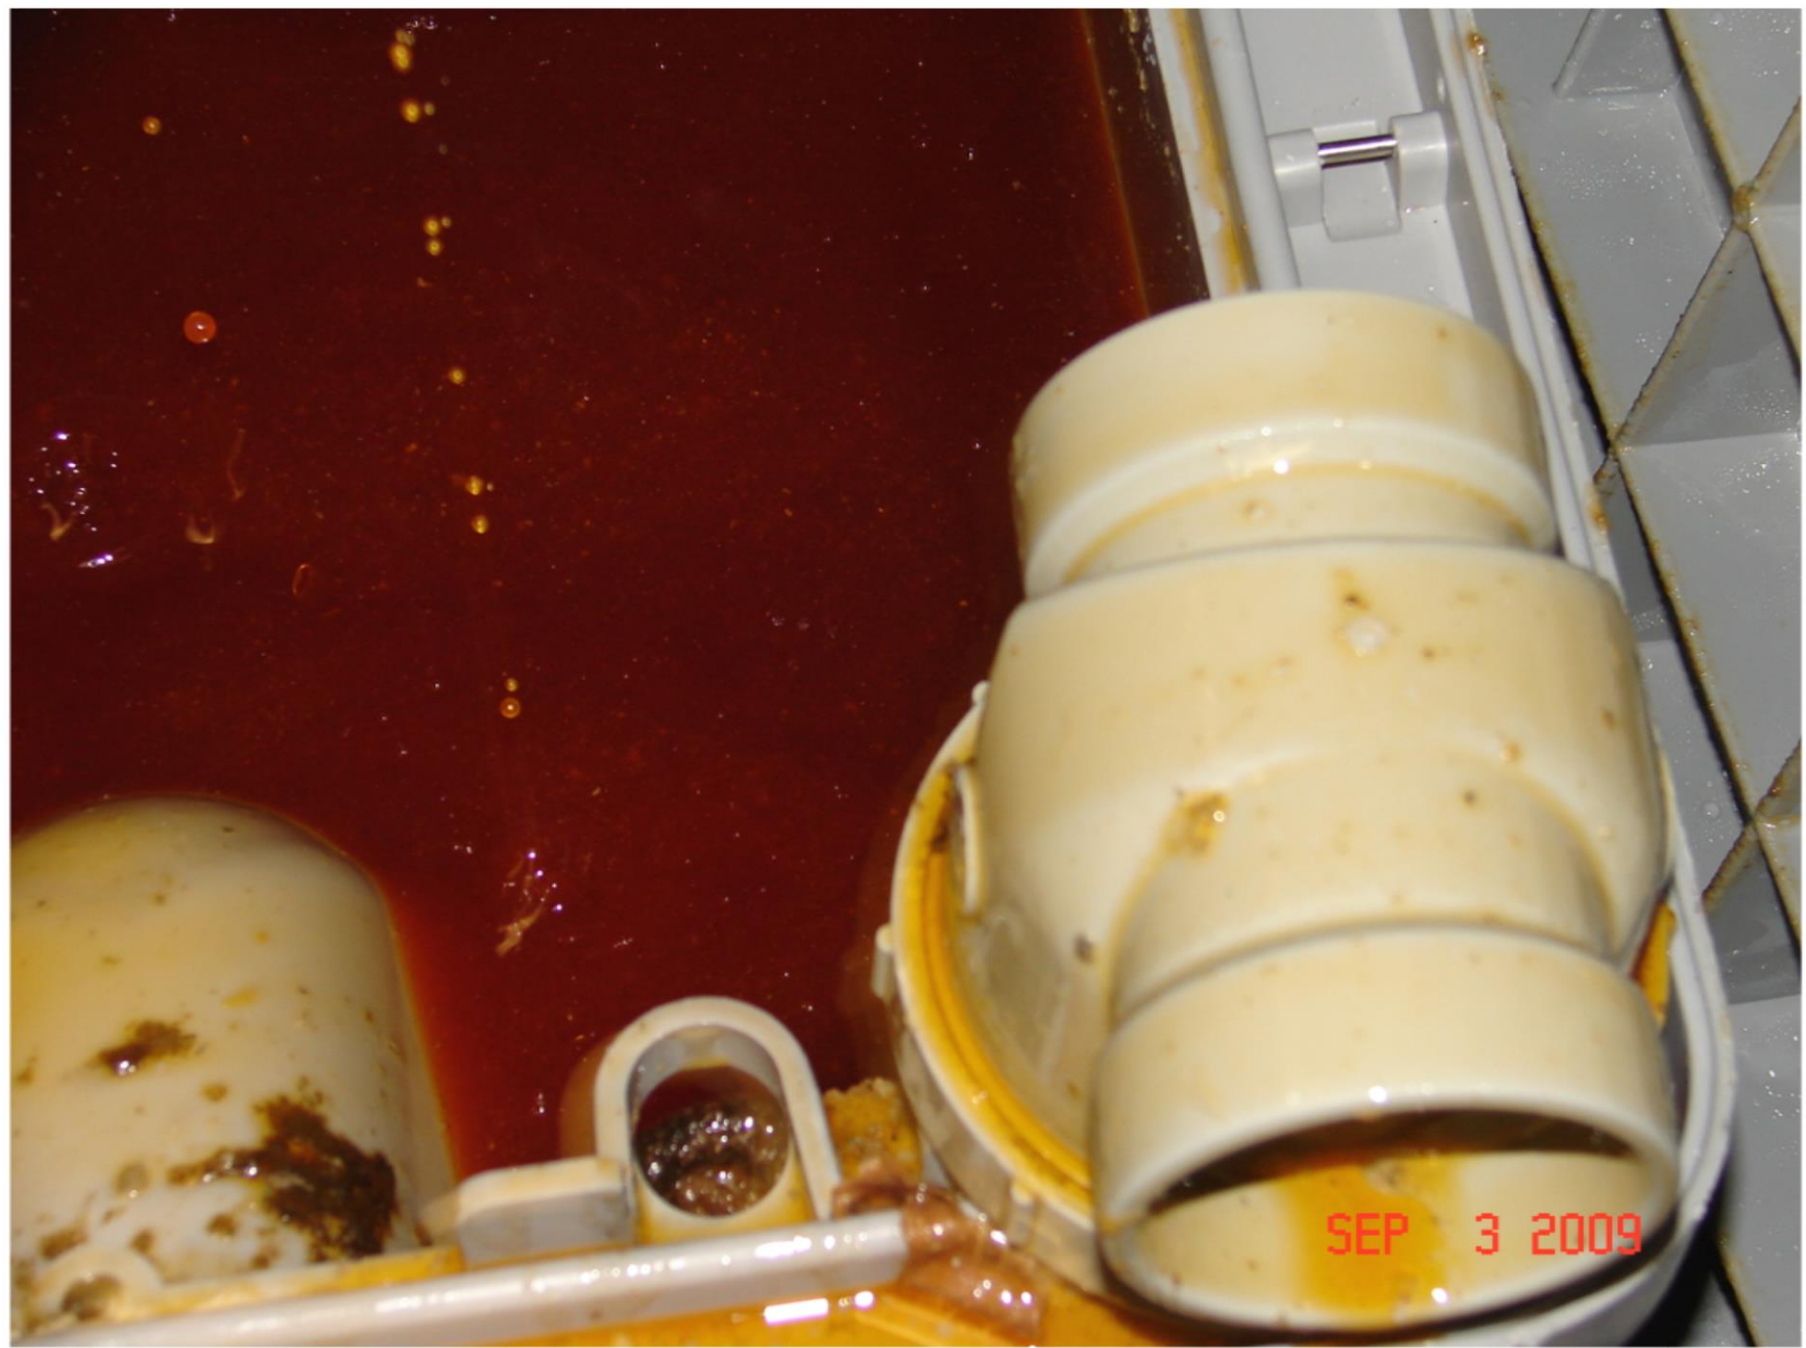





120V
15A
1000VA

TSAF

AUG 26 2009





OCT 30 2009



SEP 15 2009

INITIZE
HIGIENIZAR

OCT 5 2009





OCT 5 2009

GREASE INTERCEPTORS



INSTALLATION

Installation is no less critical than design for efficient operation of a grease interceptor. No matter how superior the design, if improperly installed, the unit's efficiency will be drastically reduced.

The interceptor should be installed as close as possible to the fixture(s) being served, as high temperature enhances grease separation. This also protects the internal piping system from grease buildup. The interceptor may be placed on the floor, partially recessed in the floor, recessed with top flush with the floor, or fully recessed below the floor, in order to accommodate piping and structural conditions. Anticipate sufficient clearance for removal of the interceptor cover and baffle for cleaning. Also, take into consideration the possibility of pipelines becoming clogged with congealed grease that may collect before reaching the grease interceptor.

Grease interceptors are not designed to perform with solid debris entering the unit. Solid material should not be permitted to enter the grease interceptor. In an application where solids are present, a solids interceptor is recommended to be used in conjunction with the grease interceptor. Grease tends to attract solid particles, growing in

FLOW CONTROL

The use of a flow control device (Z1108), furnished with all grease interceptors, is an important factor in the operation of the interceptor. Grease interceptors are designed to work properly within certain flow conditions. A flow control device placed as close to the source of liquid as possible is an important component of the assembly. The flow control device should be installed in the waste line upstream of the grease interceptor. It should be placed beyond the last connection from the fixture(s) and as close as possible to the underside of the lowest fixture. When two or more sinks or fixtures are combined and served by one interceptor, a single flow control fitting can be used. Air intake for the flow control device may terminate under the sink drain board, as high as possible, to prevent overflow or terminate in a return bend at the same height outside of the building. When a fixture is individually trapped and backvented, air intake may intersect the vent stack. All installation recommendations are subject to approval of code authority.

The air intake of the flow control must be plumbed in to either the vent





Z-1170 GREASE INTERCEPTOR

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

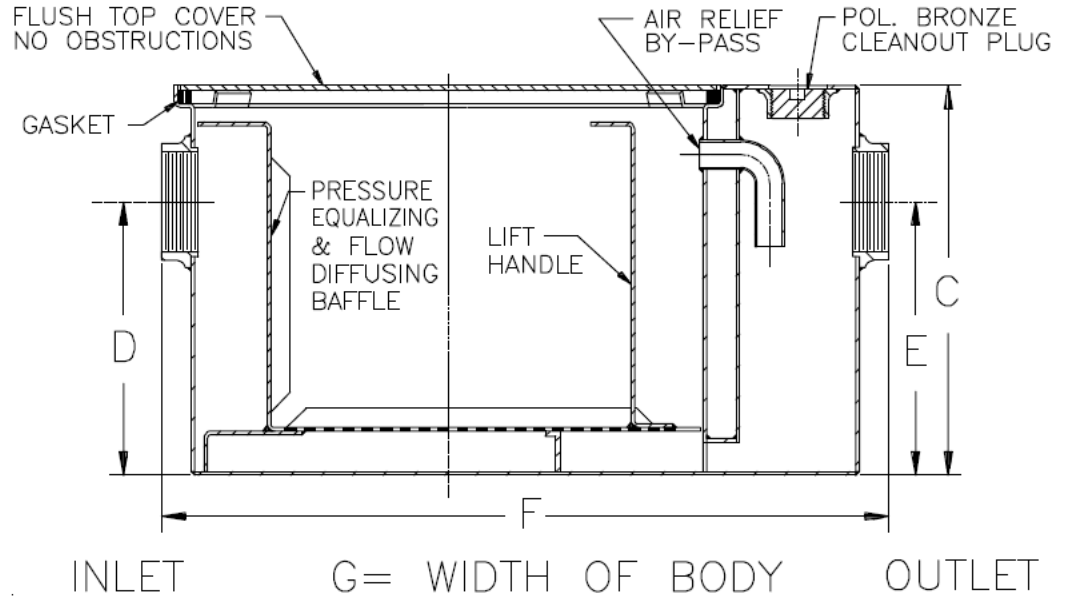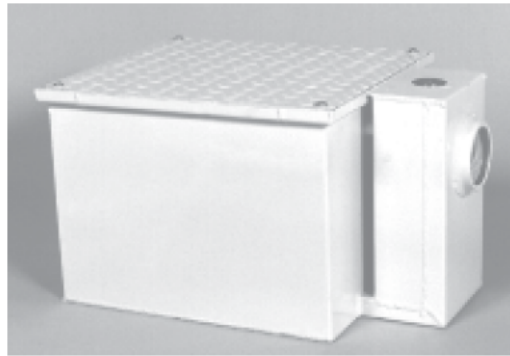

Size	Inlet/ Outlet Size**	Flow Rate G.P.M. [L]	Capacity		Approx. Wt. Lbs. [kg]	Dimensions in Inches			
			Water Gal. [L]	Grease Lbs. [kg]		C	D/E	F	G
100	2 [50]	4 [15]	3 [11]	8 [4]	42 [19]	10 [254]	7 1/4 [184]	19 [483]	9 7/8 [251]
200		7 [26]	5 [19]	14 [6]	53 [24]	11 1/4 [286]	8 1/8 [206]	20 3/8 [518]	11 7/8 [302]
300		10 [38]	6 [23]	20 [9]	66 [30]	11 3/4 [298]	8 1/4 [210]	22 5/8 [575]	14 [356]
400		15 [57]	10 [38]	30 [14]	83 [38]	13 3/8 [340]	9 3/8 [238]	24 5/8 [625]	16 3/4 [425]







JUN 29 2010





JUL 2 2008



JUL 1 2008












JAN 13 2010







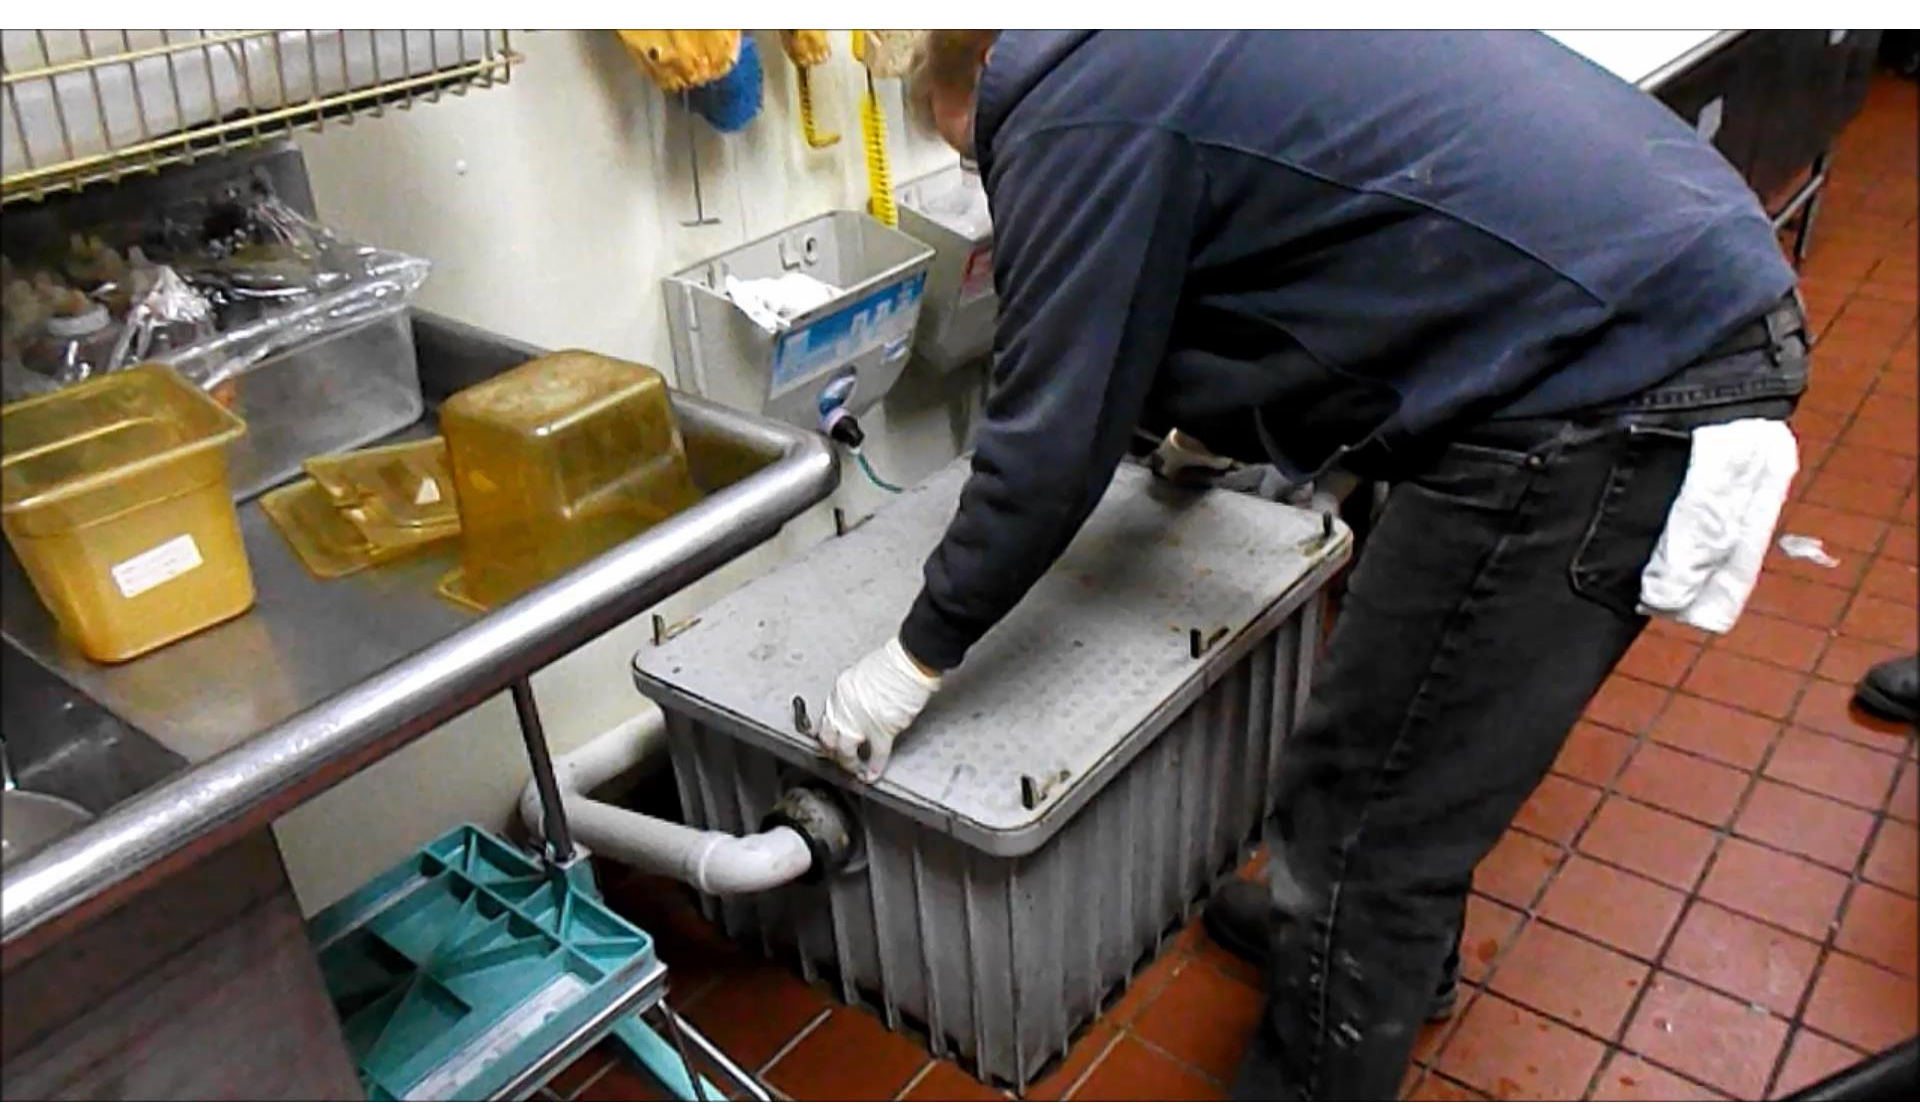

HOW A GREASE INTERCEPTOR WORKS

A grease interceptor is a passive control device that is designed to help reduce fats, oils, greases, and solids from entering the sanitary sewer collection and treatment system. Grease interceptors hold the fats, oils, greases, and solids until they can be removed and disposed of by recycling, rendering, or land application.

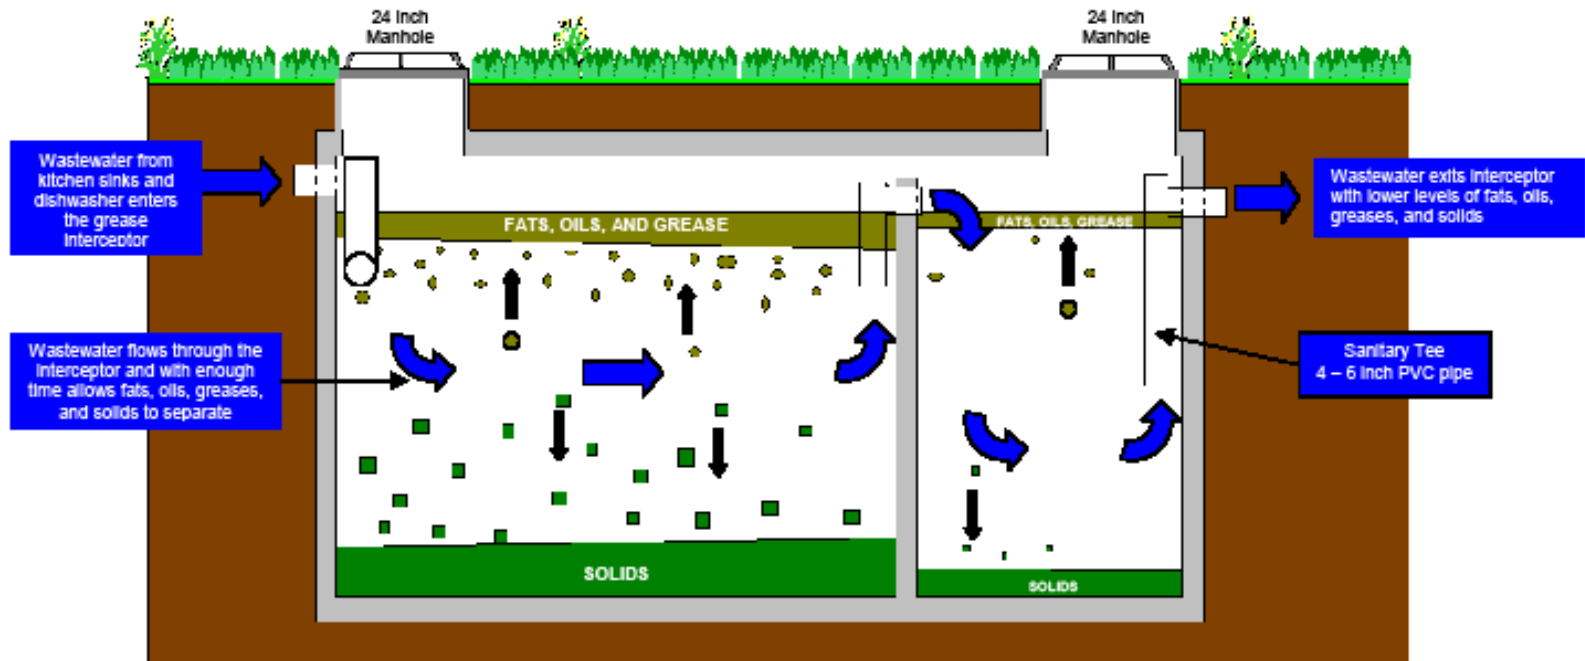


Illustration by:
Donald Smith
Town of Cary

- Grease interceptors allow wastewater flows to slow down
- With sufficient time fats, oils, greases, and solids separate from wastewater
- Fats, oils, and greases are less dense than water and float
- Solids are denser than water and sink
- Grease interceptors are designed in a variety of sizes, shapes, and constructed of various materials



AUG 18 2008

en
RESTAURANT
Hiring!



OCT 30 2008





6 10:21AM







2016/04/29 13:12:18



2016/04/29 13:15:19

Links

- <http://www.pdionline.org/>
- <http://www.pdionline.org/storage/publications/PDI-G101.pdf>
- <http://www.pdionline.org/storage/publications/Standard-PDI-G102.pdf>
- <http://www.ashlandpolytraps.com/>
- <http://www.canplasplumbing.com/>
- www.greaseremovalsystems.com
- <http://www.greenturtletech.com/>
- <http://www.jrsmith.com/>
- <http://www.schierproducts.com/>
- <http://www.thermaco.com/>
- http://www.wadedrains.com/front/f_cat_srch.php
- <http://www.zurn.com/>

Keep grease out of your drain.



A drainage service message brought to you by the
Bismarck Department of Public Works
www.bismarck.org



JUN 29 2010

**A box in the corner or a hole
in the floor does not a grease
removal device make**

Dean Woehl

Industrial Pretreatment Technician

www.bismarck.org

